## Gas Pressure Switch for DMV safety shutoff valves

GAO-A2... GMH-A2... GML-A2...





- UL Listed
- UL 353
- File # MH 16628
- CSA Certified
- CSA C22.2 No. LR 53222
- File # 201527

#### **FM Approved**

- Class 3510, 3530
- File # J.I. 1Y9A9.AF

#### Commonwealth of Massachusetts Approved Product

- Approval code G3-0106-191
- Gas pressure switch

#### **Codes and Standards**

This product is intended for installations covered by but not limited to NFPA 85, NFPA 86, UL 795, CSD-1, ANSI Z83.4, ANSI Z83.18, ANSI Z21.13, CSA B149.1, CSA B149.3 and CSA B149.6.

# DUNGS is an ISO 9001 manufacturing facility.



#### Description

The GAO-, GMH-, and GML-A2... pressure switches are compact, ventless gas pressure switches for modular valve train components.

These pressure switches are suitable for making and/or breaking a circuit when the medium pressure changes relative to the set point. The set point can be set in the field by an adjustable dial with an integrated scale. The switches incorporate a vent limiter as per UL 353 and limits the escape of gas less than 1.0 CFH of natural gas at 7 PSI if internal switch diaphragm ruptures.

#### Application

The GAO-, GMH-, and GML-A2... pressure switches are recommended for industrial and commercial heating applications with DMV dual modular valves, SV safety valves, MBC multifunctional controls, and FRI modular pressure regulators. Various mounting options allow direct mounting on the housing.

The GAO-, GMH-, and GML-A2... pressure switch is suitable for dry natural gas, propane, butane, air and other inert gases. Suitable for up to 0.1 % by volume, dry  $H_2S$ .

A "dry" gas has a dew point lower than +15 °F and its relative humidity is less than 60 %.

**GAO-A2...** SPDT pressure switch requires no auxiliary power to actuate. The GAO-A2... is suitable for making and/or breaking a circuit when the set point is exceeded or undershot. A tripped switch is indicated by a neon light after set point is exceeded or undershot. A tripped switch is indicated by a neon light after set point is exceeded or undershot. A tripped switch is indicated by a neon light after set point is exceeded or undershot.


**GMH-A2...** SPDT pressure switch requires no auxiliary power to actuate. The GMH-A2... is suitable for making and/or breaking a circuit when the set point is exceeded. A tripped switch is indicated by a neon light after set point is exceeded. Manual reset is required to reset the switch.

**GML-A2...** SPDT pressure switch requires no auxiliary power to actuate. The GML-A2... is suitable for making and/or breaking a circuit when the set point is undershot. A tripped switch is indicated by a neon light after set point is undershot. Manual reset is required to reset the switch.


#### Specifications

GAO-A2-4-2,3,5,6	7 PSI (500mbar)	
GMH- and GML-A2-4-4,6	7 PSI (500mbar)	
GAO-, GMH- and GML-A2-4-8	14 PSI (1000 mbar)	
O-ring flange connection on underside of pressure switch		
Ambient temperature	-40 °F to +140 °F (-40 °C to +60 °C)	
Medium temperature	-40 °F to +140 °F (-40 °C to +60 °C)	
Ambient temperature	-22 °F to +140 °F (-30 °C to +60 °C)	
Medium temperature	-22 °F to +140 °F (-30 °C to +60 °C)	
Housing	Aluminium	
Switch	Polycarbonate	
Diaphragm	NBR-based rubber	
Switching contact	Silver or Gold	
AC eff.	min. 24 V max. 240 V	
DC	min. 24 V max. 48 V	
Silver (Ag) contact ratings	Gold (Au) contact ratings	
AC 10 A resistive @ 120 VAC		
AC 8 A inductive @ 120 VAC		
DC min. 20 mA @ 24 VDC	DC max. 5 mA @ 5 VDC	
DC max. 1 A @ 12 - 48 VDC	DC max. 20 mA @ 24 VDC	
0.30 W energy consumption		
Screw terminals via 1/2" NPT conduit connection		
NEMA Type 4		
±15% switching point deviation referred to set point. Adjusted as pressure rises of		
as pressure falls, vertical diaphragm	n position.	
Vent Limiter Incorporates a vent limiter as per UL 353 and limits the escape of gas less than CFH of natural gas at 7 PSI if internal switch diaphragm ruptures		

GAO (Shown as a high gas limit) As pressure rises above set point, 1 NC opens, 2 NO closes, Neon light ON (fault). As pressure falls below setpoint, switch resets: 1 NC closes and 2 NO opens, Neon light off.





**GMH (Operating state shown) As pressure rises**, 2 NO closes, 1 NC opens, and Neon light ON (fault), switch trips and locks out.




GML (Operating state shown) As pressure falls, 2 NO opens, 1 NC closes, Neon light ON (fault), switch trips and locks out.

## Dimensions inch (mm) GAO-, GMH-, GML-A2...



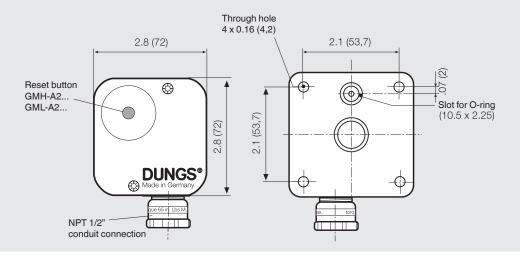


Adapters / Replacement parts / Accessories	Order No.	For equipment	Notes
A2 Mounting kit (included with switch)	226-188	GAO, GMH, GML	M4 Screws, 10.5 x 2.25 O-ring
DMV & MBC Port 3 adapter (side mount for high pressure switch	214-975	DMV-D(LE) 701 - 703 MBC series 1000 - 4000	NPT 1/2" - NPT 2"
Replacement conduit adapter	220-566	GAO, GMH, GML	PG 11 to 1/2" NPT adapter
Replacement conduit adapter	240-671	GAO, GMH, GML	M 20 to 1/2" NPT adapter
Replacement cover	228-732	GAO	
Replacement cover	233-113	GMH, GML	
Screw for replacement cover	237-675		
Replacement light	244-156	GAO, GMH, GML	120 VAC, yellow bulb
Replacement light	248-240	GAO, GMH, GML	24 VAC/VDC, green bulb
Replacement light	244-157	GAO, GMH, GML Gold contact versions	24 VAC/VDC, yellow bulb
Electrical plug for A2 (For usw with 210-318)	219-659	GAO	
Electrical plug for A2 (For usw with 210-318)	227-644	GMH, GML	
DIN connector for A2 (For use with 219-659 or 227-644)	210-318	GAO, GMH, GML	

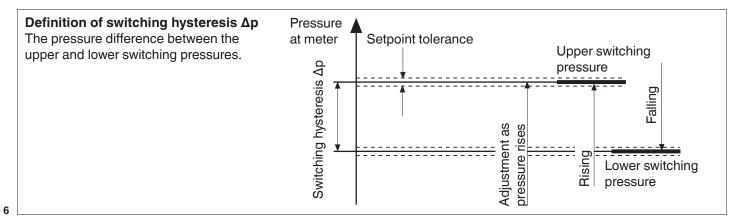

## A2 mounting options FRI gas pressure regulator

Pressure tap	Mounting possible?
1	yes
2	yes
3	yes

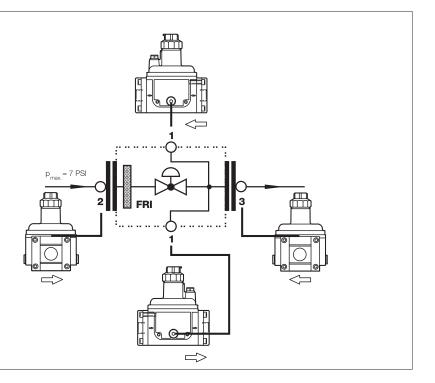


	ng options 703 Dual modular valve	
Pressure ta	ap Mounting possible?	
1	yes	
2	yes	
3	yes, with # 214-975	$\begin{array}{ccc} O & O \\ 1 & 2 & 3 \end{array}$
4	yes, horizontal yes, vertical with #225-047	
5	yes, horizontal yes, vertical with #225-047	
		$1 + \frac{1}{1} = \frac{1}{1} + $

A2 mounting DMV 525,504 Dual modular	0 - 5125/11		p <sub>max</sub> = 7 PSI
Pressure tap	Mounting possible?		
1	yes		<del>-</del> -
2	yes		1
3	yes		[
4	yes		
5	no		
6	no	5 6	6 

## A2 mounting options MBC series multifunctional control

Pressure tap	Mounting possible?
1	yes
2	yes
3	yes, with # 214-975
4	yes, horizontal yes, vertical with #225-047
5	yes, horizontal yes, vertical with #225-047

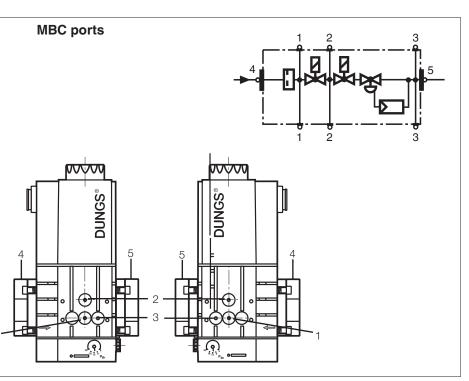



#### A2 mounting options SV 1005 and SV 1007 series safety valve

Pressure tap	Mounting possible?
1	no
2	yes
3	no
4	no

### SV 1005 and SV 1007 Series ports

(pressure switch only mounts to upstream port #2)

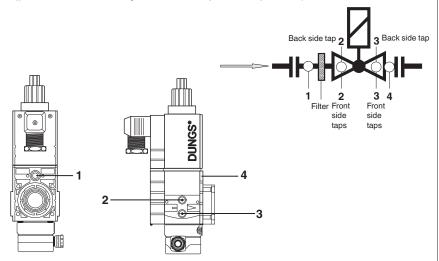

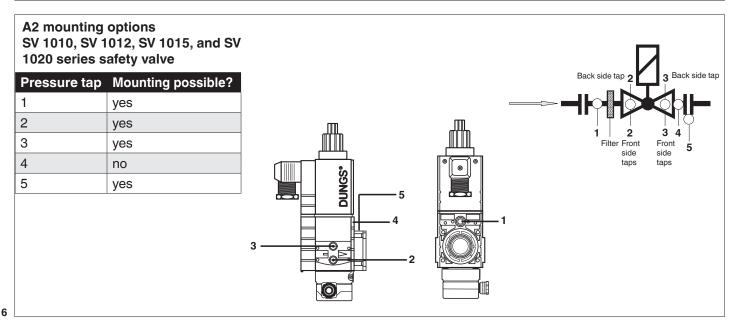

#### Gas Pressure Switch for DMV safety shutoff valves

GAO-A2... GMH-A2... GML-A2...



Туре	Version	Order No.	Setting range in. W.C.	Switching hysteresis in. W.C.	Factory Calibration
GAO-A2 pressure switch	GAO-A2-4-2 GAO-A2-4-3 GAO-A2-4-5 GAO-A2-4-6 GAO-A2-4-8	217-085A 217-086A 217-087A 217-088A 217-089A	0.16 - 1.20 0.40 - 4.00 2.00 - 20.00 12.00 - 60.00 40.00 - 200.00	≤ 0.12 ≤ 0.20 ≤ 0.40 ≤ 1.2 ≤ 4.0	ţŪ
GMH-A2 pressure switch	GMH-A2-4-4 GMH-A2-4-6 GMH-A2-4-8	217-323A 217-324A 217-325A	1.00 - 20.00 12.00 - 60.00 40.00 - 200.00		ţ₫
GML-A2 pressure switch	GML-A2-4-4 GML-A2-4-6 GML-A2-4-8	217-337A 217-338A 217-339A	1.00 - 20.00 12.00 - 60.00 40.00 - 200.00		ţ₫
All switches have 120 VAC neon lights factory installed					

We reserve the right to make any changes in the interest of technical progress.

Karl Dungs Inc.3890 Pheasant Ridge Drive NESuite 150Blaine, MN 55449, U.S.A.Phone 763 582-1700Fax763 582-1799e-mail info@karldungsusa.comInternet http://www.dungs.com/usa/

Karl Dungs GmbH & Co. KG P.O. Box 12 29 D-73602 Schorndorf, Germany Phone +49 (0)7181-804-0 Fax +49 (0)7181-804-166 e-mail info@dungs.com Internet http://www.dungs.com