

Solenoid valves for gas VAS, Double solenoid valves VCS

Technical Information · GB
3.1.0.2 Edition 03.08




- Safety shut-off of gaseous fuels, a further development of the solenoid valves for gas VG and VS
- Suitable for a max. inlet pressure of 500 mbar (7 psig)
- Easy installation into a system
- Compact design saves space
- No extra valve required owing to integrated flow adjustment
- Check indication by blue LED
- Position indicator with integral visual indicator
- Suitable for high-duty cycling
- Higher flow rates with the same nominal size
- EC type-tested and certified
- VAS/VCS: FM and CSA approved
- AGA approved

Table of contents

| | |
|---|-----------|
| Solenoid valves for gas VAS, Double solenoid valves VCS . | 1 |
| Table of contents | 2 |
| 1 Application | 4 |
| 1.1 Examples of application. | 5 |
| 1.1.1 Solenoid valve for gas VAS 1–3, Double solenoid valve VCS 1–3 | 6 |
| 1.1.2 Gas solenoid valve with inlet and outlet pressure switch . | 7 |
| 1.1.3 Double solenoid valve VCS with damping unit | 7 |
| 1.1.4 Solenoid valve for gas VAS 6–9, Double solenoid valve VCS 6–9 | 8 |
| 1.1.5 Solenoid valve for gas VAS 6–9, Double solenoid valve VCS 6–9 with connection for adapter plates . | 9 |
| 1.1.6 Gas solenoid valve with pilot gas valve and pressure switch. | 10 |
| 1.1.7 Double solenoid valve with tightness control | 10 |
| 2 Certification | 11 |
| 3 Function | 12 |
| 3.1 VAS..N, quick opening | 13 |
| 3.2 Solenoid valve for gas VAS..L, slow-opening | 14 |
| 3.3 Solenoid valve for gas VAS..S, proof of closure switch | 15 |
| 3.4 Animation | 16 |
| 3.5 VAS connection diagram | 17 |
| 3.5.1 VAS with M20 cable gland | 17 |
| 3.5.2 VAS with plug | 17 |
| 3.5.3 VCS with M20 cable gland | 17 |
| 3.5.4 VCS with plug | 17 |
| 4 Replacement possibilities | 18 |
| 4.1 Solenoid valve for gas VG is to be replaced by VAS . . | 18 |
| 4.1.1 Search for an order number or type | 19 |
| 4.2 MODULINE solenoid valves for gas VS is to be replaced by VAS | 20 |
| 5 Flow rate | 22 |
| 5.1 VAS | 22 |
| 5.1.1 Calculate nominal size | 22 |
| 5.2 VCS | 23 |
| 5.2.1 Calculate nominal size | 23 |
| 5.3 k _v value | 24 |
| 6 Selection | 25 |
| 6.1 Solenoid valve for gas VAS | 25 |
| 6.2 Double solenoid valve VCS | 28 |
| 7 Project planning information | 32 |
| 7.1 Installation | 32 |
| 8 Accessories | 33 |
| 8.1 Gas pressure switch | 33 |
| 8.1.1 DG..VC for VAS/VCS | 33 |
| 8.1.2 DG..VCT for VAS..T/VCS..T | 33 |
| 8.1.3 Installation on VAS 1–3 | 33 |
| 8.1.4 Installation on VAS 6–9 | 34 |
| 8.1.5 Installation on VCS 6–9 | 34 |
| 8.2 Bypass/pilot gas valve VAS 1 | 35 |
| 8.2.1 Scope of delivery, VAS 1 attached to VAS 1 | 35 |
| 8.2.2 Scope of delivery, VAS 1 attached to VAS 2, VAS 3 | 35 |
| 8.2.3 Scope of delivery, VAS 1 attached to VAS/VCS 6–9 | 36 |
| 8.2.4 Flow rate, VAS 1 attached to VAS 1, VAS 2, VAS 3 | 37 |
| 8.2.5 Flow rate, VAS 1 attached to VAS/VCS 6 – 9 | 38 |
| 8.3 Bypass/pilot gas valve VBY 8 | 39 |
| 8.3.1 Scope of delivery, as bypass valve | 39 |
| 8.3.2 Scope of delivery, as pilot gas valve | 39 |
| 8.3.3 Selection | 39 |
| 8.3.4 Flow rate | 40 |
| 8.3.5 Technical data | 40 |



| | |
|--|-----------|
| 8.4 Tightness control TC 116V | 41 |
| 8.5 Pressure test points | 41 |
| 8.6 Grommet | 42 |
| 8.7 Attachment block | 42 |
| 8.8 Flange set for Moduline | 42 |
| 8.9 Adapter plates for VAS/VCS 6–9 | 43 |
| 8.9.1 Bypass adapter plate | 43 |
| 8.9.2 Measuring adapter plate | 43 |
| 8.9.3 Pipe adapter plate for VCS 6–9 | 43 |
| 8.10 Seal set VA 1–3 | 44 |
| 9 Technical data | 45 |
| 9.1 Dimensions | 47 |
| 9.1.1 VAS with Rp internal thread [mm] | 47 |
| 9.1.2 VAS..T with NPT internal thread [inch] | 48 |
| 9.1.3 VAS/VCS with ISO flange | 49 |
| 9.1.4 VAS/VCS..T with ANSI flange [inch] | 50 |
| 9.2 Conversion factors | 51 |
| 10 Maintenance cycles | 52 |
| Feedback | 53 |
| Contact | 53 |

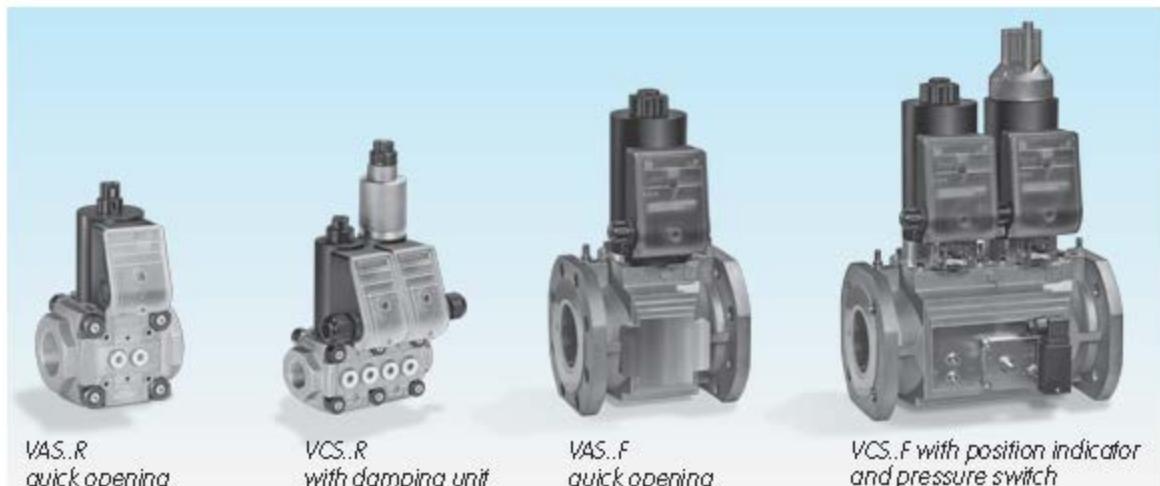

*VAS.R
quick opening*

*VCS.R
with damping unit*

*VAS.F
quick opening*

*VCS.F with position indicator
and pressure switch*

The modular design principle allows the individual components of the VAS, VCS Series to be easily assembled: e.g. quick opening, slow opening, with position indicator and visual indicator, slow opening with attached pressure switch.

1 Application

Solenoid valves for gas VAS and double solenoid valves VCS for safeguarding and controlling the air and gas supply to gas burners and gas appliances. For use in gas control and safety systems in all sectors of the iron, steel, glass and ceramics industries, also in commercial heat generation, such as the packaging, paper and foodstuffs industries.

1.1 Examples of application


Ceramics industry




Aluminium industry:
curing oven for
wheel rims



Foodstuffs industry:
baking oven

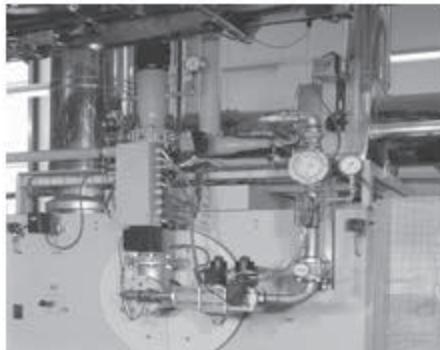

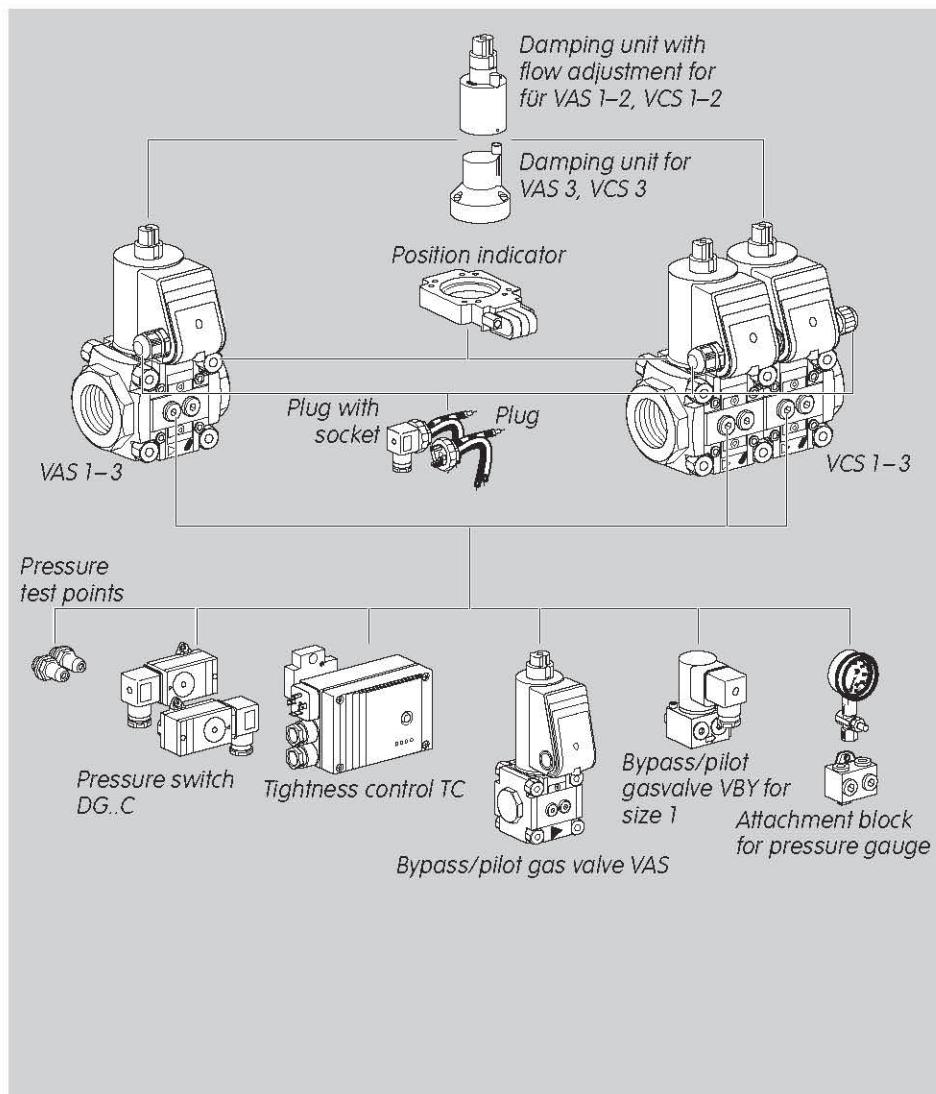


1.1.1 Solenoid valve for gas VAS 1-3, Double solenoid valve VCS 1-3

With threaded flange for pipe connections from DN 10 to 65.


Modularly expandable with:

- Damping unit
- Position indicator
- Plug (with or without socket)
- Pressure test points
- Pressure switch DG..C for inlet and/or outlet pressure
- Tightness control TC
- Bypass/pilot gas valve
- Attachment block for the connection of a pressure gauge, for example.

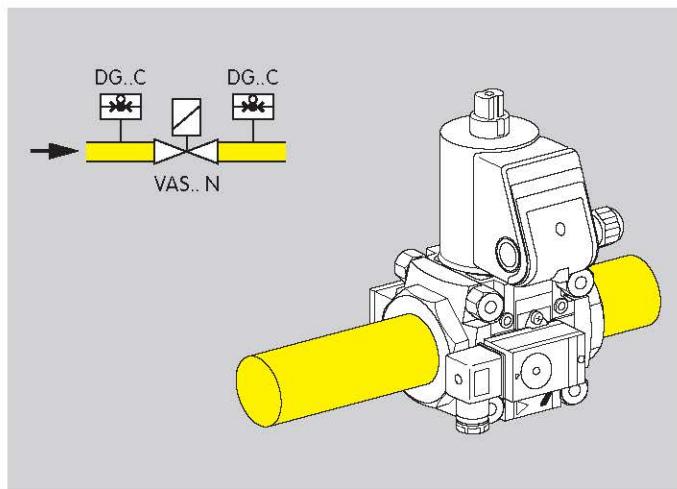

1.1.2 Gas solenoid valve with inlet and outlet pressure switch


VAS..N, quick opening,
pressure switch DG..C (DG..VT) for inlet pressure p_e and out-
let pressure p_a

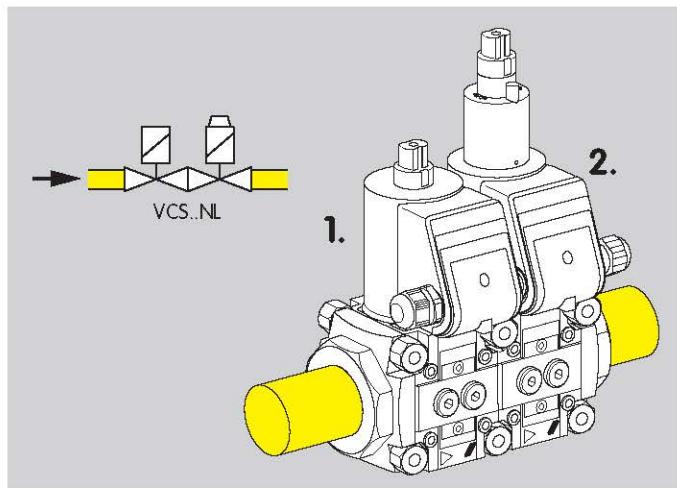

1.1.3 Double solenoid valve VCS with damping unit

VCS..NL,

1st valve: quick opening, quick closing, with flow adjustment,
2nd valve: slow opening, quick closing.

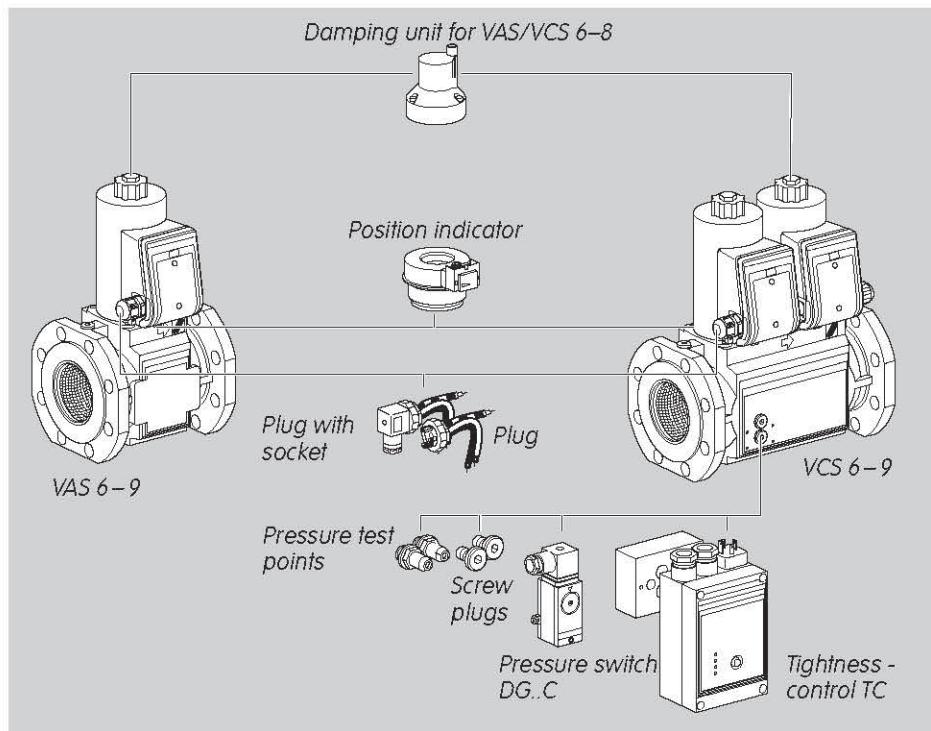

1.1.4 Solenoid valve for gas VAS 6–9, Double solenoid valve VCS 6–9


Gas solenoid valve and double solenoid valve with flanged connection (ISO or ANSI) for pipe connections from DN 65 to 125.

Modularly expandable with:

- Damping unit for VAS/VCS 6–8
- Position indicator
- Plug
- Plug with socket

VCS 6–9 with two threaded connections for:

- Screw plugs
- Pressure test points
- Pressure switch DG..C for inlet/inter-space pressure
- Tightness control TC

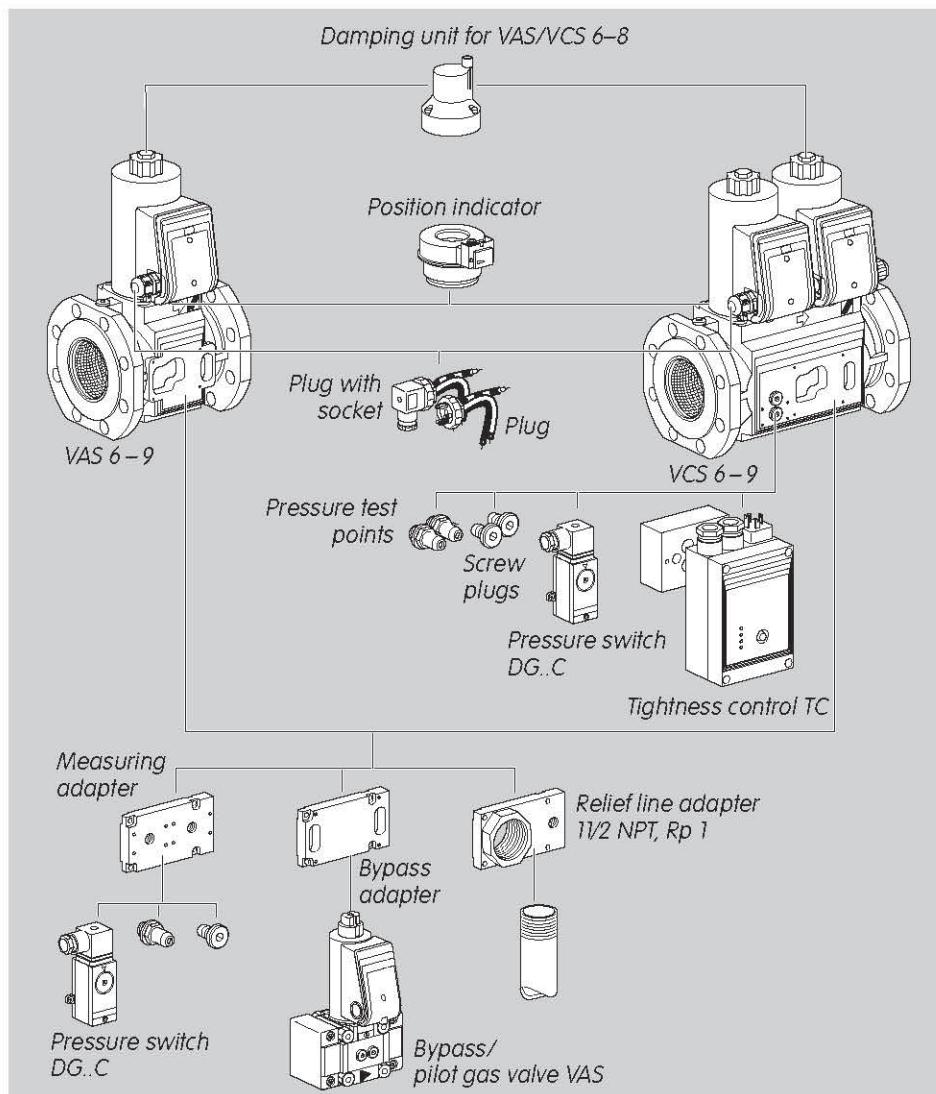

1.1.5 Solenoid valve for gas VAS 6-9, Double solenoid valve VCS 6-9 with connection for adapter plates

Gas solenoid valve and double solenoid valve with flanged connection (ISO or ANSI) for pipe connections from DN 65 to 125.

Modularly expandable with:

- Damping unit for VAS/VCS 6-8
- Position indicator
- Plug
- Plug with socket

With adapter plates, expandable with:


- Pressure switch DG..C
VAS 6-9: for inlet/outlet pressure
VCS 6-9: for interspace/outlet pressure
- Pressure test points
- Screw plug
- Bypass or pilot gas valve VAS

VCS 6-9

With two threaded connections for:


- Screw plugs
- Pressure test points
- Pressure switch DG..C for inlet/interspace pressure
- Tightness control TC

Expandable with relief line adapter (1 1/2 NPT, Rp 1) for relief line.

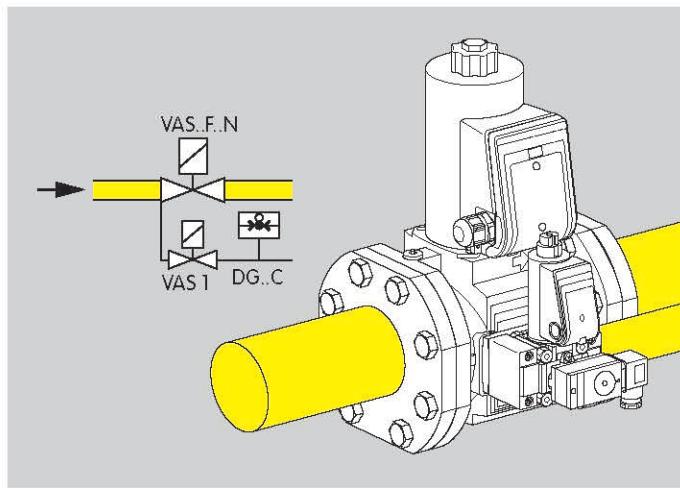

1.1.6 Gas solenoid valve with pilot gas valve and pressure switch

VAS..F.N: quick opening, quick closing,
VAS 1 as pilot gas valve with pressure switch DG..C.

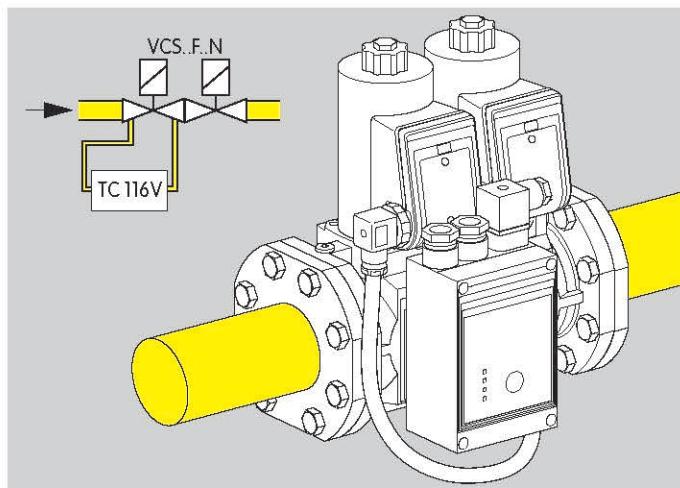

1.1.7 Double solenoid valve with tightness control

VCS..F.N: quick opening, quick closing valves,

tightness control TC 116V.



2 Certification

EC type-tested and certified
pursuant to

- Gas Appliances Directive (90/396/EEC) in conjunction with EN 161, EN 13611

Meets the requirements of the

- Low Voltage Directive (2006/95/EC) in conjunction with the relevant standards,
- EMC Directive (2004/108/EC) in conjunction with EN 55014-1.

FM approved

Factory Mutual Research Class: 7410 and 7411 Safety overpressure slam shut valves.

Designed for applications pursuant to NFPA 85 and NFPA 86.

CSA approved

Canadian Standard Association – ANSI Z21.21 and CSA 6.5

UL approval

In preparation.

AGA approved

Australian Gas Association

3 Function

The gas solenoid valve VAS is closed when it is disconnected from the power supply.


Opening: Connect the system to the electrical power supply (alternating voltage will be rectified). The blue LED lights up. The coil's magnetic field pulls the armature with the attached valve disc upwards. The gas solenoid valve VAS opens. The double valve seat means that the forces from the inlet pressure are divided almost equally between the two valve seats.

Closing: Disconnect the VAS from the electrical power supply. The blue LED goes out. The armature is pressed into its initial position by the closing spring. The gas solenoid valve closes within 1 s.

The strainer in the inlet of the gas solenoid valve prevents deposits of dirt particles on the valve seats. The pressure loss through the strainer is very low.


VAS 1–8..N, VAS 1–2..L:

The flow rate can be varied by a flow adjusting screw on the actuator within a range from 20 to 100%. On VAS 1–3, the setting can be monitored on an indicator.

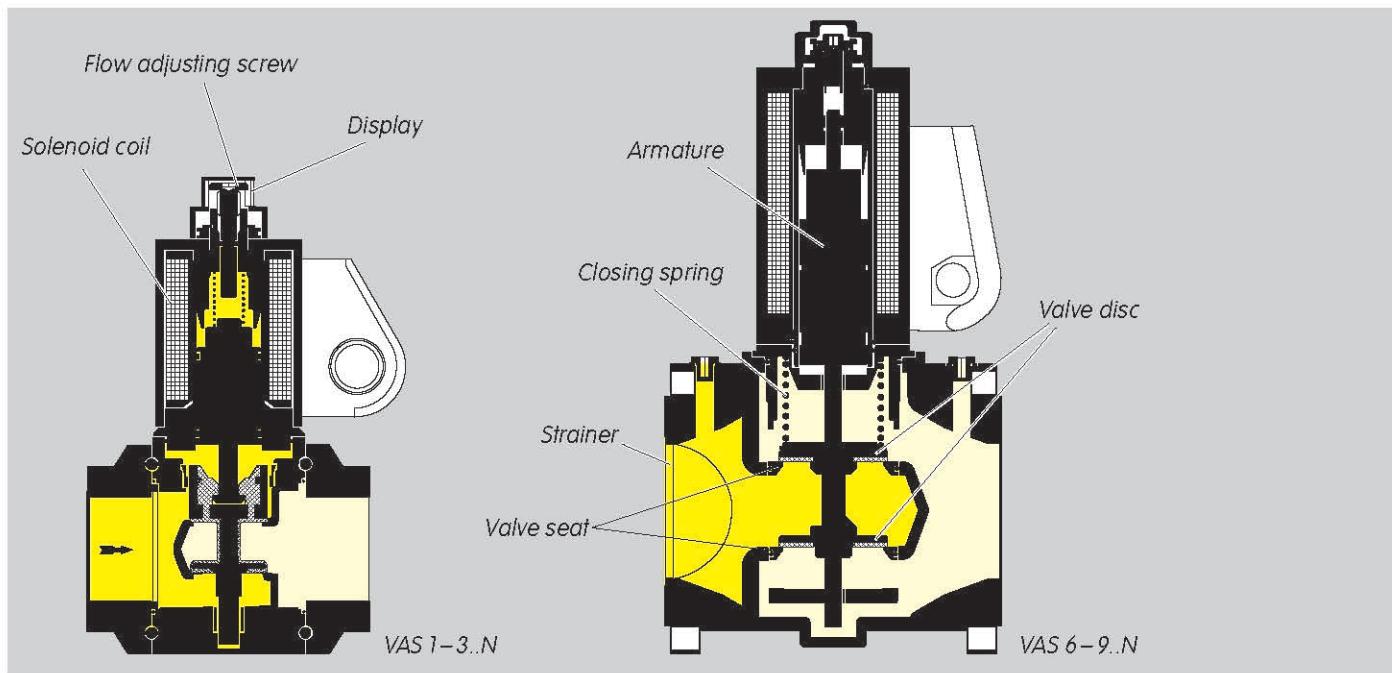

3.1 VAS..N, quick opening

The solenoid valve for gas VAS..N opens within 0.5 s.

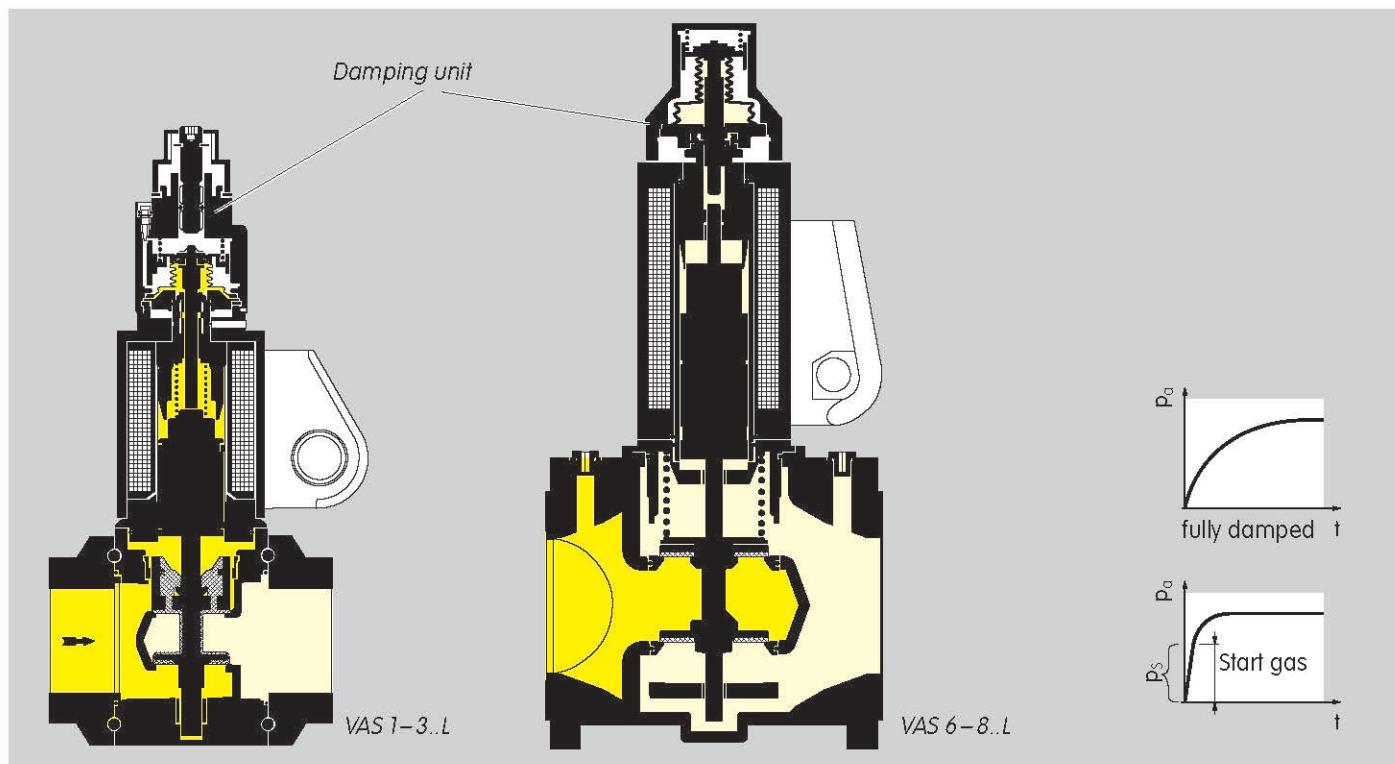



3.2 Solenoid valve for gas VAS..L, slow-opening

The solenoid valve for gas VAS..L opens within 10 s.

Start gas rate adjustment: The gas solenoid valve opens with a quick initial lift and then continues slowly until it is fully open. The start gas rate can be set. This setting is required, for example if a tightness control TC is to be used.

By turning the damping unit the start gas rate can be set between 0 and 70%:

turning it clockwise will reduce the start gas rate, turning it anti-clockwise will increase the gas start rate.

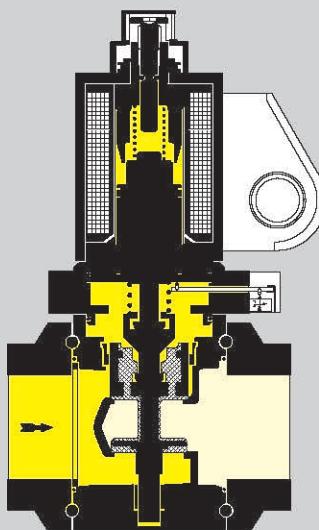

3.3 Solenoid valve for gas VAS..S, proof of closure switch

Opening: When the gas solenoid valve is opened, the proof of closure switch is operated first. The visual indicator is activated. The "open" signal is marked in red. Only then does the double valve seat open to release the volume of gas (overtravel principle).

Closing: The gas solenoid valve VAS is disconnected from the voltage supply and the closing spring presses the double valve disc on to the valve seat. Then the proof of closure switch is actuated. The visual indicator is white for "closed".


The actuator cannot be rotated on a gas solenoid valve with a proof of closure switch.

NOTE: NFPA 86 – the following must be taken into account as soon as the capacity of the pilot or main burner exceeds 117 kW (400,000 BTU/h): Safety shut-off valve VAS..S must be fitted with a visual indicator and proof of closure switch, and the burner-side pressure regulator with gas solenoid valve VAX..S must also be fitted with a visual indicator. One gas solenoid valve must be verifiably closed. The closed position can be verified using the position indicator of the gas solenoid valve VAS..S.

valvario® VAS

krom
schroder

- VAS..N
schnell öffnend/quick opening
- VAS..N.S schnell öffnend, mit Meldeschalter/
quick opening, with position indicator
- VAS..L
langsam öffnend/slow opening
- VAS..L
Startgasmenge/Start gas rate

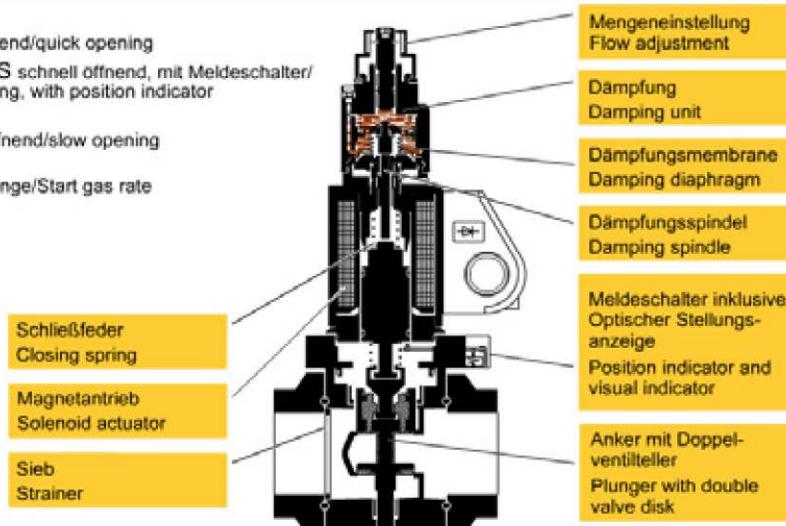

3.4 Animation

The interactive animation shows the function of the gas solenoid valve VAS.

Click on the picture. The animation can be controlled using the control bar at the bottom of the window (as on a DVD player).

To play the animation, you will need Adobe Reader 7 or a newer version. If you do not have Adobe Reader on your system, you

can download it from the Internet. Go to www.adobe.com, click on "Get Adobe Reader" and follow the instructions.

If the animation does not start to play, you can download it from the document library (Docuthek) as an independent application.

4 Replacement possibilities

4.1 Solenoid valve for gas VG is to be replaced by VAS

| Type | | Solenoid valve for gas | Solenoid valve for gas | Type |
|-------|--------|--|--|------|
| VG | | | | VAS |
| 10/15 | DN 10 | internal 15 mm (0.59") | Size 1 DN 10 | 110 |
| 15 | DN 15 | | Size 1 DN 15 | 115 |
| 15/12 | DN 15 | internal 12 mm (0.47") | — | — |
| 20 | DN 20 | | Size 1 DN 20 | 120 |
| 25 | DN 25 | | Size 1 DN 25 | 125 |
| 25/15 | DN 25 | internal 15 mm (0.59") | — | — |
| 40/32 | DN 40 | internal 32 mm (1.26") | Size 2 DN 40 | 240 |
| 40 | DN 40 | | Size 2 DN 40 | 240 |
| 40/33 | DN 40 | internal 33 mm (1.30") | — | — |
| 50 | DN 50 | | Size 3 DN 50 | 350 |
| 50/39 | DN 50 | internal 39 mm (1.54") | — | — |
| 50/65 | DN 50 | internal 65 mm (2.59") | Size 3 DN 50 | 350 |
| 65 | DN 65 | | Size 3 DN 65 | 365 |
| 65 | | | Size 6 DN 65 | 665 |
| 65/49 | DN 65 | internal 49 mm (1.93") | — | — |
| 80 | DN 80 | | Size 7 DN 80 | 780 |
| 100 | DN 100 | | Size 8 DN 100 | 8100 |
| T | | T-product | T-product | T |
| R | | Rp internal thread | Rp internal thread | R |
| N | | NPT internal thread | NPT internal thread | N |
| F | | ISO flange | ISO flange | |
| A | | ANSI flange | ANSI flange | |
| 02 | | p _e max.: 200 mbar (2 psig) | p _e max.: 500 mbar (7 psig) | ● |
| 03 | | 360 mbar (5 psig) | 500 mbar (7 psig) | ● |
| 10 | | 1000 mbar (14.5 psig) | — | — |
| 18 | | 1800 mbar (26.1 psig) | — | — |
| N | | Quick opening | Quick opening | /N |
| L | | Slow opening | Slow opening | /L |

Cont.

| | | | |
|----------------|---|---|-------------|
| K | Mains voltage: 24 V DC | Mains voltage: 24 V DC | K |
| Q | 120 V AC | 120 V AC | Q |
| T | 220/240 V AC | 230 V AC | W |
| 3 | Electrical connection via terminals | Electrical connection via terminals | 3 |
| 6 | Electrical connection via socket | Electrical connection via socket | ○ |
| 9 | Metal terminal connection box | Electrical connection via terminals | 3 |
| 1 | Screw plug at the inlet | Screw plug at the inlet and outlet | ● |
| 3 | Screw plug at the inlet and outlet | Screw plug at the inlet and outlet | ● |
| 4 | Pressure test point at the inlet | Pressure test point at the inlet and outlet* | ○ |
| 6 | Pressure test point at the inlet and outlet | Pressure test point at the inlet and outlet* | ○ |
| D | Flow adjustment | Flow adjustment*** | ● |
| S | Position indicator | Position indicator with visual indicator** | S |
| G | Position indicator for 24 V | Position indicator for 24 V with visual indicator** | G |
| OCS | Valve stem overtravel switch | Position indicator with visual indicator** | S |
| CPS | Position indicator | Position indicator with visual indicator** | S |
| VI | Visual indicator | Position indicator with visual indicator** | S |
| M | Suitable for biologically produced methane | Suitable for biologically produced methane | ● |
| V | Viton valve disc seal | Viton valve disc seal | - |
| VG 25R02NT31DM | Example | Example | VAS 125R/NW |

● = standard, ○ = available

* Pressure test points may be attached at the left and/or right-hand side.

** Position indicator with visual indicator can be attached at the left- or right-hand side.

*** Flow adjustment for VAS/VCL.N 1 - 3, VAS/VCL 1 – 2..L

4.1.1 Search for an order number or type

| | | |
|--------------|---------------------|--|
| Order No. VG | Type designation VG |  |
| | | Hits: 0 |

VG is to be replaced by VAS


Order No. VAS

Type designation VAS

4.2 MODULINE solenoid valves for gas VS is to be replaced by VAS

| Type | Flange | Solenoid valve for gas | Solenoid valve for gas | Flange | Type |
|------|--|------------------------|---------------------------------------|--------|------|
| VS | | | | | VAS |
| 115 | 3/8" | Size 115 | Size 1 | DN 10 | 110 |
| 125 | | Size 125 | | | |
| 115 | 1/2" | Size 115 | Size 1 | DN 15 | 115 |
| 125 | | Size 125 | | | |
| 115 | 3/4" | Size 115 | Size 1 | DN 20 | 120 |
| 125 | | Size 125 | | | |
| 115 | 1" | Size 115 | Size 1 | DN 25 | 125 |
| 125 | | Size 125 | | | |
| 230 | 1" | Size 232 | Size 2 | DN 25 | 225 |
| 240 | | Size 240 | | | |
| 232 | 1 1/2" | Size 232 | Size 2 | DN 40 | 240 |
| 240 | | Size 240 | | | |
| 350 | 1 1/2" | Size 350 | Size 3 | DN 40 | 340 |
| 350 | 2" | Size 350 | Size 3 | DN 50 | 350 |
| ML | MODULINE + connection flanges Rp internal thread | | Rp internal thread | | R |
| TML | MODULINE + connection flanges NPT internal thread | | NPT internal thread | | N |
| 02 | p _e max. 200 mbar (2 psig) | | p _e max. 500 mbar (7 psig) | | ● |
| 03 | p _e max. 360 mbar (3 psig) | | p _e max. 500 mbar (7 psig) | | ● |
| N | Quick opening | | Quick opening | | /N |
| L | Slow opening | | Slow opening | | /L |
| D | Flow adjustment | | Flow adjustment* | | ● |


* Flow adjustment for VAS/VCL..N 1 -3, VAS/VCL 1 – 2..L.



Cont.

| | | | |
|--|-------------------------------------|---|---------------------------------|
| K | Mains voltage: 24 VDC | Mains voltage: 24 V DC | K |
| Q | 120 V AC | 120 V AC | Q |
| T | 220/240 V AC | 230 V AC | W |
| 3 | Electrical connection via terminals | Electrical connection via terminals | 3 |
| 6 | Electrical connection via socket | Electrical connection via socket | ○ |
| 9 | Metal terminal connection box | Electrical connection via terminals | 3 |
| ● | Pressure test point at the inlet | Pressure test point at the inlet and outlet | ○ |
| S | Position indicator | Position indicator | S |
| G | Position indicator for 24 V | Position indicator for 24 V | G |
| M | non-ferrous metals | non-ferrous metals | ● |
| V | Viton valve disc seal | - | - |
| VS 240ML02LT3 with Rp 1½ connection flanges | Example | Example | VAS 240R/LW with test points |

● = standard, ○ = available

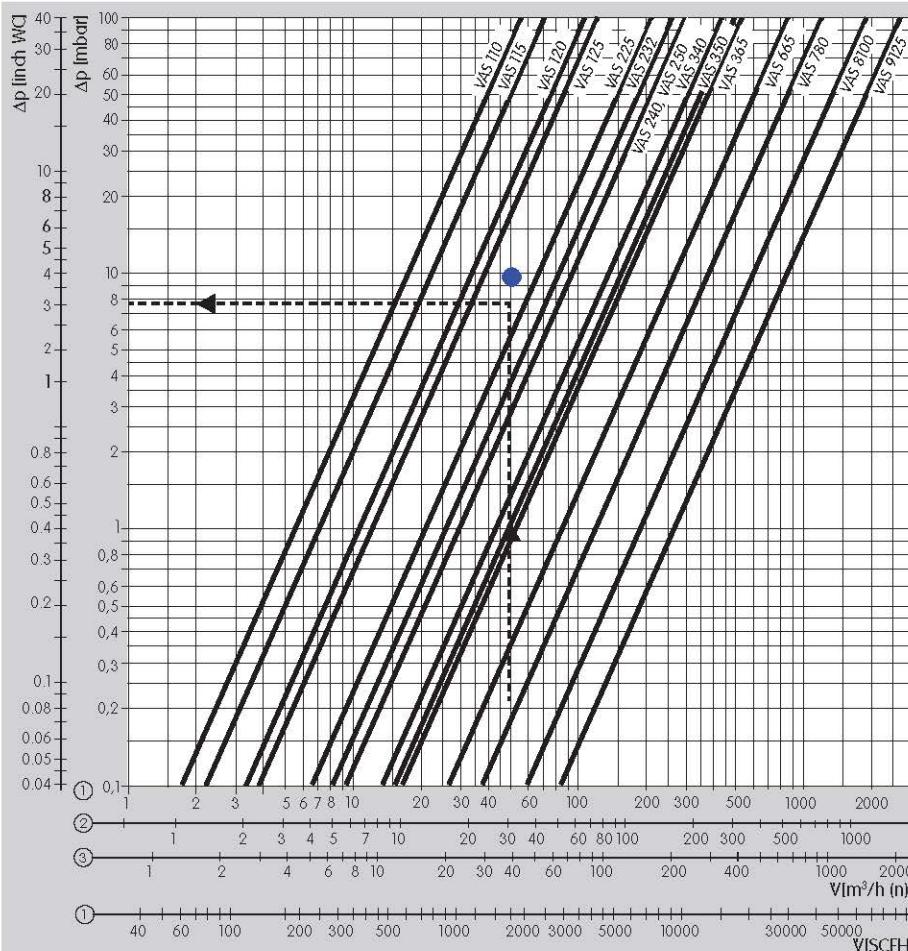

① = Natural gas ($\rho = 0.80 \text{ kg/m}^3$)

② = Propane ($\rho = 2.01 \text{ kg/m}^3$)

③ = Air ($\rho = 1.29 \text{ kg/m}^3$)

The characteristic flow rate curves have been measured with the specified flanges and a fitted strainer.

5 Flow rate

5.1 VAS

Reading instructions: Should operating cubic metres (m^3/h (b)) have been used in the flow rate diagram, instead of standard cubic metres m^3/h (n), then the pressure lost read must be multiplied by the absolute inlet pressure in bar (1 + positive pressure in bar).

Example:

Inlet pressure p_e (positive pressure) = 0.3 bar,
Gas type: Natural gas,

Operating flow rate $V = 50 \text{ m}^3/\text{h}$ (b),

Δp in the diagram = 5.6 mbar,
 $\Delta p = 5.6 \text{ mbar} \times (1 + 0.3) = 7.3 \text{ mbar}$ on the solenoid valve VAS 225.

5.1.1 Calculate nominal size

Standard

T-product

Erdgas

0,80 kg/m³

Flow rate V (standard)

64,8 m³/h

Inlet pressure p_e

300 mbar

Δp_{\max}

10,0 mbar

Medium temperature

0 °C

Flow rate V (operation)

50,0 m³/h

Product


Δp
[mbar]

V_{\min}
[m³/h]

V
[m/s]

| VAS | 225 | 7,3 | 13,8 | 22 |
|-----|-----|-----|------|----|
| VAS | 232 | 4,6 | 11,0 | 13 |
| VAS | 240 | 3,7 | 9,9 | 10 |
| VAS | 250 | 3,7 | 9,9 | 6 |
| VAS | 340 | 1,8 | 10,9 | 10 |
| VAS | 350 | 1,4 | 9,6 | 6 |

Flow rate

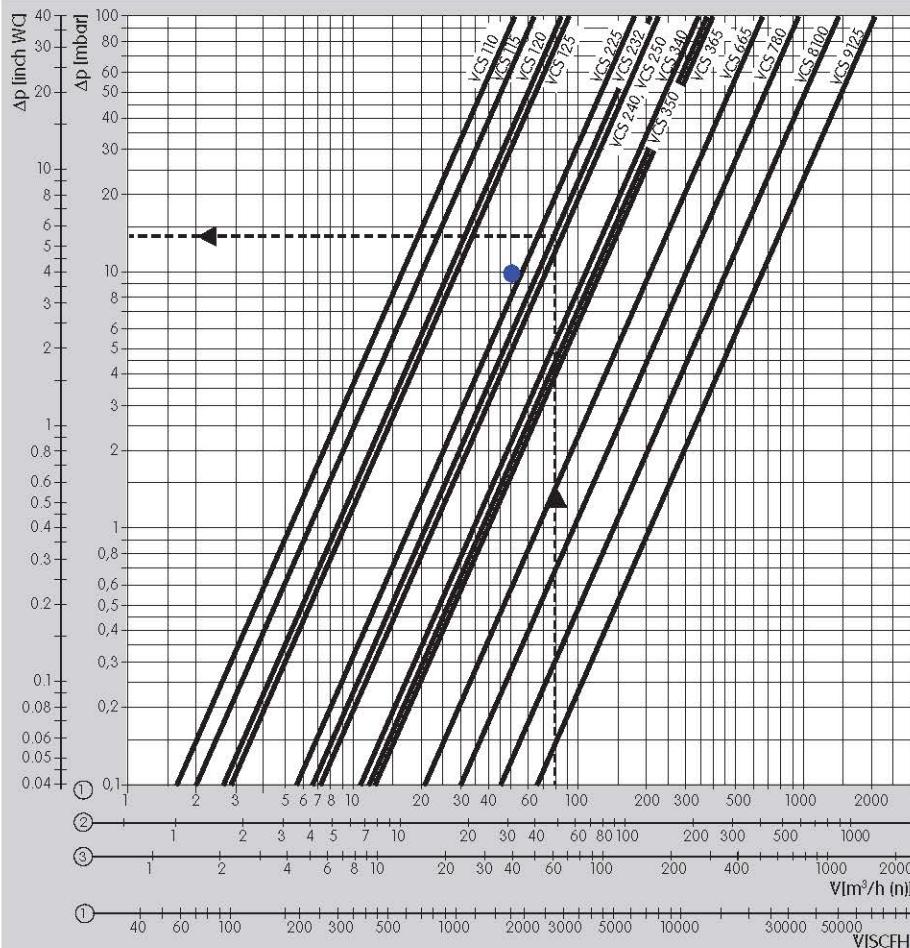

① = Natural gas ($\rho = 0.80 \text{ kg/m}^3$)

② = Propane ($\rho = 2.01 \text{ kg/m}^3$)

③ = Air ($\rho = 1.29 \text{ kg/m}^3$)

The characteristic flow rate curves have been measured with the specified flanges and a fitted strainer.

5.2 VCS

Reading instructions: Should operating cubic metres (m³/h (b)) have been used in the flow rate diagram, instead of standard cubic metres m³/h (n), then the pressure lost read must be multiplied by the absolute inlet pressure in bar (1 + positive pressure in bar).

Example:

Inlet pressure p_e (positive pressure) = 0.2 bar,
Gas type: Natural gas,

Operating flow rate $V = 80 \text{ m}^3/\text{h}$ (b),

Δp in the diagram = 14.5 mbar,
 $\Delta p = 14.5 \text{ mbar} \times (1 + 0.2) = 17.4 \text{ mbar}$ on
the solenoid valve VCS 232.

5.2.1 Calculate nominal size

Standard T-product

Erdgas 0,80 kg/m³

Flow rate V (standard) 64,8 m³/h

Inlet pressure p_e 300 mbar

Δp_{\max} 10,0 mbar

Medium temperature 0 °C

Flow rate V (operation) 50,0 m³/h

| Product | Δp [mbar] | V_{\min} [m ³ /h] | V [m/s] |
|---------|----------------------|-----------------------------------|--------------|
|---------|----------------------|-----------------------------------|--------------|

| | | | |
|---------|-----|------|----|
| VCS 232 | 7,3 | 13,9 | 13 |
| VCS 240 | 6,4 | 13,0 | 10 |
| VCS 250 | 6,3 | 12,8 | 6 |
| VCS 340 | 2,8 | 13,6 | 10 |
| VCS 350 | 2,3 | 12,5 | 6 |
| VCS 365 | 2,1 | 11,8 | 4 |

5.3 k_v value

The size and nominal flange width is determined using the flow rate diagram or by calculation using the k_v value.

$V_{(n)}$ = Flow rate (standard state) [m³/h]

k_v = Valve coefficient (see table)

Δp = Pressure loss [bar]

p_a = Outlet pressure (absolute) [bar]

ρ_n = Density [kg/m³] (air 1.29, natural gas 0.80, propane 2.01, butane 2.71)

T = Medium temperature (absolute) [K]

(see conversion factors)

$$k_v = \frac{V_{(n)}}{514} \cdot \sqrt{\frac{\rho_n \cdot T}{\Delta p \cdot p_a}} \quad V_{(n)} = 514 \cdot k_v \cdot \sqrt{\frac{\Delta p \cdot p_a}{\rho_n \cdot T}}$$

$$\Delta p = \left(\frac{V_{(n)}}{514 \cdot k_v} \right)^2 \cdot \frac{\rho_n \cdot T}{p_a}$$

| VAS | k_v max. m ³ /h | k_v min. m ³ /h | VCS | k_v max. m ³ /h | k_v min. m ³ /h |
|----------|---------------------------------|---------------------------------|----------|---------------------------------|---------------------------------|
| VAS 110 | 5.0 | 2 | VCS 110 | 4.7 | 2 |
| VAS 115 | 6.4 | 2 | VCS 115 | 5.7 | 2 |
| VAS 120 | 9.6 | 2 | VCS 120 | 7.6 | 2 |
| VAS 125 | 10.9 | 2 | VCS 125 | 8.1 | 2 |
| VAS 225 | 19.2 | 5.3 | VCS 225 | 16.3 | 5.3 |
| VAS 232 | 24.1 | 5.3 | VCS 232 | 19.1 | 5.3 |
| VAS 240 | 26.9 | 5.3 | VCS 240 | 20.4 | 5.3 |
| VAS 250 | 26.9 | 5.3 | VCS 250 | 20.7 | 5.3 |
| VAS 340 | 39.1 | 8.5 | VCS 340 | 31.2 | 8.5 |
| VAS 350 | 44.4 | 8.5 | VCS 350 | 34.1 | 8.5 |
| VAS 365 | 47.4 | 8.5 | VCS 365 | 35.9 | 8.5 |
| VAS 665 | 69.0 | — | VCS 665 | 61.0 | — |
| VAS 780 | 112.0 | — | VCS 780 | 87.0 | — |
| VAS 8100 | 171.0 | — | VCS 8100 | 131.0 | — |
| VAS 9125 | 251.0 | — | VCS 9125 | 193.0 | — |

Example

We want to find the size and nominal flange width for a gas solenoid valve VAS.

We have the maximum flow rate $V_{(n)}$ max, the inlet pressure p_e and the natural gas temperature T.

$$V_{(n)}$$
 max = 60 m³/h

$$p_e = 70 \text{ mbar} = 0.07 \text{ bar} \Rightarrow$$

$$p_e \text{ absolute} = 0.07 \text{ bar} + 1 \text{ bar} = 1.07 \text{ bar}$$

$$\Delta p_{\max} = 0.01 \text{ bar (desired)}$$

$$p_a \text{ absolute} = p_e \text{ absolute} - \Delta p_{\max}$$

$$p_a \text{ absolute} = 1.07 \text{ bar} - 0.01 \text{ bar} = 1.06 \text{ bar}$$

$$T = 27^\circ\text{C} \Rightarrow$$

$$T_{\text{absolute}} = 27 + 273 \text{ K} = 300 \text{ K}$$

$$k_v = \frac{60}{514} \cdot \sqrt{\frac{0.83 \cdot 300}{0.01 \cdot 1.06}} = 17.9$$

The gas solenoid valve is selected using the next higher k_v value (see table): VAS 225.

6 Selection

6.1 Solenoid valve for gas VAS

| Type | T | - -0 10 15 20 25 32 40 50 65 80 100 125 | / - /-0 /10 /15 /20 /25 /32 /40 /50 /65 /80 /100 /125 |
|--|---|---|---|
| VAS 1 | ○ | ● ● ● ● ● ● | ● ● ● ● ● ● |
| VAS 2 | ○ | ● | ● ● ● ● ● |
| VAS 3 | ○ | ● | ● ● ● ● ● |
| VAS 6 | ○ | | ● ● |
| VAS 7 | ○ | | ● ● |
| VAS 8 | ○ | | ● |
| VAS 9 | ○ | | ● |
| T-Product = T | | | |
| Inlet flange nominal size | | | |
| No inlet flange = - | | | |
| Blind flange = -0 | | | |
| Outlet flange nominal size | | | |
| No outlet flange = - | | | |
| Blind flange = /0 | | | |
| Specification may be omitted if outlet = inlet | | | |



Cont.

| Type | R | N | F | A | 05 ⁴⁾ | N | L | K | Q | W | A | SII | GII | RII | LII | 3 ⁴⁾ | P | M |
|--|--------------------|---|-----------------|---|------------------|---|---|---|---|---|---|-----|-----|-----|-----|-----------------|---|---|
| VAS 1 | ● | ○ | | | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VAS 2 | ● | ○ | ○ ²⁾ | | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VAS 3 | ● | ○ | ○ ²⁾ | | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VAS 6 | | | ● | ○ | | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| VAS 7 | | | ● | ○ | | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| VAS 8 | | | ● | ○ | | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| VAS 9 | | | ● | ○ | | ● | ● | | | | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| RP internal thread | = R | | | | | | | | | | | | | | | | | |
| NPT internal thread | = N | | | | | | | | | | | | | | | | | |
| ISO flange | = F ²⁾ | | | | | | | | | | | | | | | | | |
| ANSI flange | = A | | | | | | | | | | | | | | | | | |
| Max. inlet pressure p _e max. 500 mbar | = 05 ⁴⁾ | | | | | | | | | | | | | | | | | |
| Quick opening, quick closing | = N | | | | | | | | | | | | | | | | | |
| Slow opening, quick closing | = L | | | | | | | | | | | | | | | | | |
| Mains voltage: 24 V DC | = K | | | | | | | | | | | | | | | | | |
| 120 V AC; 50/60 Hz | = Q | | | | | | | | | | | | | | | | | |
| 230 V AC; 50/60 Hz | = W | | | | | | | | | | | | | | | | | |
| 120–230 V AC; 50/60 Hz | = A | | | | | | | | | | | | | | | | | |
| Position indicator with visual indicator | = SII | | | | | | | | | | | | | | | | | |
| Position indicator for 24 V with visual indicator | = GII | | | | | | | | | | | | | | | | | |
| Viewed from the right (in the direction of flow) | = RII | | | | | | | | | | | | | | | | | |
| Viewed from the left (in the direction of flow) | = LII | | | | | | | | | | | | | | | | | |
| Electrical connection: | | | | | | | | | | | | | | | | | | |
| M20 cable gland | = 3 ⁴⁾ | | | | | | | | | | | | | | | | | |
| Plug with socket | | | | | | | | | | | | | | | | | | |
| Plug without socket | | | | | | | | | | | | | | | | | | |
| Measuring connection at the top: 2 screw plugs at the inlet and outlet | = P | | | | | | | | | | | | | | | | | |
| 2 pressure test points at the inlet and outlet | = M | | | | | | | | | | | | | | | | | |

¹⁾ VAS 1–3: Position indicator and bypass-/pilot gas valve cannot be fitted together on one side.²⁾ For inlet and outlet flanges of the same nominal size: VAS 240 and VAS 350 can be supplied.⁴⁾ The specifications are only included in the type designation for VAS 6–9.

Cont.

| Type | /P4) | /M4) | /14) | /24) | /34) | /44) | 5) | 5) | 1) | /B 4 5) | /Z 4 5) | V | E | /-4) | P4) | M4) | 14) | 24) | 34) | 44) | -4) |
|-------|------|------|------|------|------|------|----|----|----|---------|---------|---|---|------|-----|-----|-----|-----|-----|-----|-----|
| VAS 1 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 2 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 3 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 6 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 7 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 8 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VAS 9 | ○ | ○ | ○ | ○ | ○ | ○ | | | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |

Accessories, right, inlet:

Screw plugs = /P4)

Pressure test point for inlet pressure p_e = /M4)

Gas pressure switch (see accessories): DG..VC 17 = /14)

DG..VC 40 = /24)

DG..VC 110 = /34)

DG..VC 300 = /44)

Bypass valve VBY, fitted = 5)

Pilot gas valve VBY, fitted = 5)

Main valve attachment side = 4)

Bypass valve VAS 1, fitted = /B 4|5)

Pilot gas valve VAS 1, fitted = /Z 4|5)

Prepared for breather line 1½ NPT = V

Prepared for breather line Rp 1 = E

None accessories = /-4)

Accessories, right, outlet:

Screw plug = P4)

Pressure test point for outlet pressure p_o = M4)

Gas pressure switch (see accessories): DG..VC 17 = 14)

DG..VC 40 = 24)

DG..VC 110 = 34)

DG..VC 300 = 44)


None accessories = -4)

Accessories on left-hand side equivalent to those on right-hand side²⁾³⁾ The "accessories on the left-hand side" have the same type code as the "accessories on the right-hand side" (see order example: 1 screw plug each at the inlet and outlet on the left-hand side = /PP).⁴⁾ The specifications are only included in the type designation for VAS 6–9.⁵⁾ VAS 1–3: Position indicator and bypass-/pilot gas valve cannot be fitted together on one side. The "accessories on the left-hand side" have the same type code as the "accessories on the right-hand side" (see order example: 1 screw plug each at the inlet and outlet on the left-hand side = /PP).

● = standard, ○ = available

Order example

VAS 665F05NW3P/B-/PP

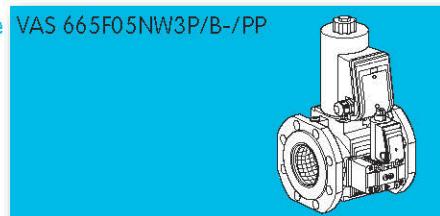

6.2 Double solenoid valve VCS

| Type | T | - | 0 | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 125 | /- | /-0 | /10 | /15 | /20 | /25 | /32 | /40 | /50 | /65 | /80 | /100 | /125 | | | | |
|---------------|---|---|---|----|----|----|----|----|----|----|----|----|-----|-----|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|---|--|--|--|
| VCS 1 | ○ | ● | ● | ● | ● | ● | ● | | | | | | | | ● | ● | ● | ● | ● | ● | ● | | | | | | | | | | |
| VCS 2 | ○ | ● | | | ● | ● | ● | ● | | | | | | | ● | | | ● | ● | ● | ● | ● | ● | ● | | | | | | | |
| VCS 3 | ○ | ● | | | | | | ● | ● | ● | ● | | | | ● | | | ● | ● | ● | ● | ● | ● | ● | ● | | | | | | |
| VCS 6 | ○ | | | | | | | | | | ● | ● | | | | | | | | | | | | ● | ● | | | | | | |
| VCS 7 | ○ | | | | | | | | | | | ● | | | | | | | | | | | | | | ● | | | | | |
| VCS 8 | ○ | | | | | | | | | | | ● | | | | | | | | | | | | | | | ● | | | | |
| VCS 9 | ○ | | | | | | | | | | | | ● | | | | | | | | | | | | | | | ● | | | |
| T-Product = T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Inlet flange nominal size

No inlet flange = -

Blind flange = -0

Outlet flange nominal size

No outlet flange = -

Blind flange = /0

Specification may be omitted if outlet = inlet



Cont.

| Type | R | N | F | A | 05 ³⁾ | N | L | N | L | K | Q | W | A | S ¹⁾ | G ¹⁾ | R ¹⁾ | L ¹⁾ | 3 ³⁾ | P | M |
|-------|---|---|-----------------|---|------------------|---|---|---|---|---|---|---|---|-----------------|-----------------|-----------------|-----------------|-----------------|---|---|
| VCS 1 | ● | ○ | | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VCS 2 | ● | ○ | ○ ²⁾ | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VCS 3 | ● | ○ | ○ ²⁾ | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ○ |
| VCS 6 | | ● | ○ | | ● | ● | ● | | | ● | ● | ● | ● | ● | ○ | ○ | ○ | ● | ○ | ● |
| VCS 7 | | ● | ○ | | | ● | ● | ● | ● | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| VCS 8 | | ● | ○ | | | ● | ● | | | ● | ● | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |
| VCS 9 | | ● | ○ | | | ● | ● | | | ● | | ● | ● | ○ | ○ | ○ | ○ | ● | ○ | ● |

Rp internal thread = R

NPT internal thread = N

ISO flange = F²⁾

ANSI flange = A

Max. inlet pressure p_e max. 500 mbar = 05³⁾

1st valve quick opening, quick closing = N

1st valve slow opening, quick closing = L

2nd valve quick opening, quick closing = N

2nd valve slow opening, quick closing = L

Mains voltage: 24 V DC = K

120 V AC; 50/60 Hz = Q

230 V AC; 50/60 Hz = W

120–230 V AC; 50/60 Hz = A

Position indicator with visual indicator = S¹⁾Position indicator for 24 V with visual indicator = G¹⁾Viewed from the right (in the direction of flow) = R¹⁾Viewed from the left (in the direction of flow) = L¹⁾

Electrical connection:

M20 cable gland = 3³⁾

Plug with socket

Plug without socket

Measuring connections at the top of the inlet/outlet flange: Screw plugs = P

Pressure test points = M

¹⁾ VCS 1–3: Position indicator and bypass-/pilot gas valve cannot be fitted together on one side.²⁾ For inlet and outlet flanges of the same nominal size: VAS 240 and VAS 350.³⁾ The specifications are only included in the type designation for VAS 6–9.

Cont.

| Type | /P ¹⁾ | /M ¹⁾ | /1 ¹⁾ | /2 ¹⁾ | /3 ¹⁾ | /4 ¹⁾ | 5) | 5) | 1) | /B ^{1) 5)} | /Z ^{1) 5)} | /-1) | P ¹⁾ | M ¹⁾ | 1) ¹⁾ | 2 ¹⁾ | 3 ¹⁾ | 4 ¹⁾ | -1) |
|-------|------------------|------------------|------------------|------------------|------------------|------------------|----|----|----|---------------------|---------------------|------|-----------------|-----------------|------------------|-----------------|-----------------|-----------------|-----|
| VCS 1 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 2 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 3 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 6 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 7 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 8 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 9 | ○ | ○ | ○ | ○ | ○ | ○ | | | ○ | ○ | ○ | | ○ | ○ | ○ | ○ | ○ | ○ | ○ |

Accessories, right, inlet:

Screw plugs = /P¹⁾Pressure test point p_e = /M¹⁾

Gas pressure switch (see accessories): DG 17VC = /1¹⁾
DG 40VC = /2¹⁾
DG 110VC = /3¹⁾
DG 300VC = /4¹⁾

Bypass valve VBY, fitted = 5)

Pilot gas valve VBY, fitted = 5)

Main valve attachment side = 1)

Bypass valve VAS 1, fitted = /B^{1) 5)}Pilot gas valve VAS 1, fitted = /Z^{1) 5)}

None accessories = /-1)

Accessories, right, interspace 1:

Screw plug = P¹⁾Pressure test point p_d = M1

Gas pressure switch: DG 17VC = 1¹⁾
DG 40VC = 2¹⁾
DG 110VC = 3¹⁾
DG 300VC = 4¹⁾

None accessories = -1)

¹⁾ The specifications are only included in the type designation for VAS 6–9.⁵⁾ VCS 1–3: Position indicator and bypass-/pilot gas valve cannot be fitted together on one side.

Cont.

| Type | P ¹⁾ | M ¹⁾ | 1 ¹⁾ | 2 ¹⁾ | 3 ¹⁾ | 4 ¹⁾ | 5 ¹⁾ | 1 ¹⁾ | B ¹⁽⁵⁾ | Z ¹⁽⁵⁾ | V | E | -1 ¹⁾ | P ¹⁾ | M ¹⁾ | 1 ¹⁾ | 2 ¹⁾ | 3 ¹⁾ | 4 ¹⁾ | -1 ¹⁾ |
|-------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-------------------|-------------------|---|---|------------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|------------------|
| VCS 1 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 2 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 3 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 6 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ● | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ● |
| VCS 7 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 8 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |
| VCS 9 | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ | ○ |

Accessories, right, interspace 2:

Screw plugs = P¹⁾Pressure test point for inlet pressure p_e = M¹⁾Gas pressure switch: DG 17VC = 1¹⁾DG 40VC = 2¹⁾DG 110VC = 3¹⁾DG 300VC = 4¹⁾Bypass valve VBY, fitted = 5¹⁾Pilot gas valve VBY, fitted = 5¹⁾Main valve attachment side = 1¹⁾Bypass valve VAS 1, fitted = B¹⁽⁵⁾Pilot gas valve VAS 1, fitted = Z¹⁽⁵⁾

Prepared for breather line 1½ NPT = V

Prepared for breather line Rp 1 = E

None accessories = -1¹⁾

Accessories, right, outlet:

Screw plug = P¹⁾Pressure test point p_d = M¹⁾Gas pressure switch: DG..VC 17 = 1¹⁾DG..VC 40 = 2¹⁾DG..VC 110 = 3¹⁾DG..VC 300 = 4¹⁾None accessories = -1¹⁾Accessories on left-hand side equivalent to those on right-hand side ⁴⁾¹⁾ The specifications are only included in the type designation for VAS 6–9.²⁾ The "accessories on the left-hand side" have the same type code as the "accessories on the right-hand side"


(see order example: 1 screw plug each at the inlet, interspace 1, interspace 2 and outlet on the left-hand side = /PPPP).


³⁾ VCS 1–3: Position indicator and bypass-/pilot gas valve cannot be fitted together on one side.

● = standard, ○ = available

Order example


VCS 665F05NLWSR3P/1PB-/PPPP

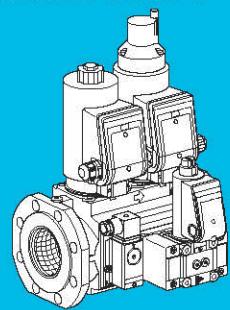




7 Project planning information

The inlet pressure p_e and the outlet pressure p_a can be measured at the pressure test points at both ends.





If more than three valVario controls are installed in line, the controls must be supported.




7.1 Installation

Installation position: black solenoid actuator in the vertical upright position or tilted up to the horizontal, not upside down.




Gas solenoid valve VAS and double solenoid valve VCS must not be in contact with masonry.

Do not store or install the unit in the open air.




Sealing material and thread cuttings must not be allowed to get into the valve housing.

We recommend that a filter be installed upstream of every system.






Ensure that there is sufficient space for installation and adjustment.



The solenoid body heats up during operation depending on ambient temperature and voltage.

The seals in some gas compression fittings are approved for temperatures of up to 70°C. This temperature limit will not be exceeded if the flow through the pipe is at least 1 m³/h of gas and the maximum ambient temperature is 50°C.

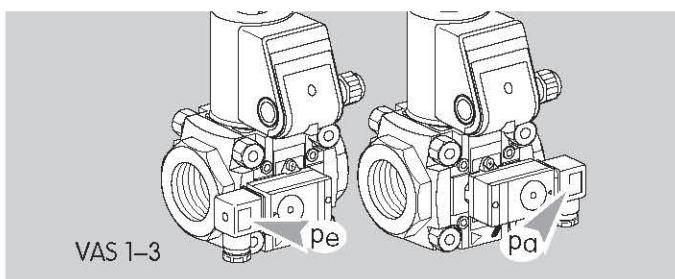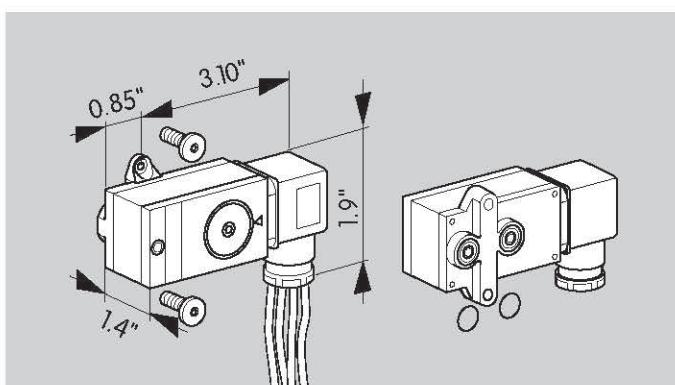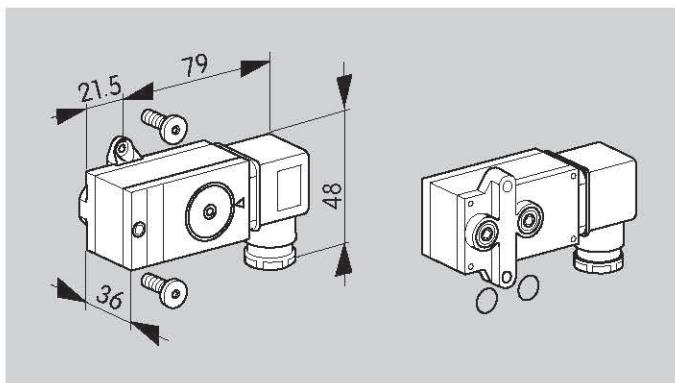

8 Accessories

8.1 Gas pressure switch

8.1.1 DG..VC for VAS/VCS

| Type | Identification No. (see Selection table) | Adjusting range [mbar] |
|----------|---|---------------------------|
| DG 17VC | 1 | 2...17 |
| DG 40VC | 2 | 5...40 |
| DG 110VC | 3 | 30...110 |
| DG 300VC | 4 | 100...300 |

Scope of delivery:

- 1 x pressure switch for gas,
- 2 x retaining screws,
- 2 x sealing rings.

8.1.2 DG..VCT for VAS..T/VCS..T

| Type | Identification No. (see Selection table) | Adjusting range ["WC] |
|-----------|---|--------------------------|
| DG 17VCT | 1 | 0.8...6.8 |
| DG 40VCT | 2 | 2...16 |
| DG 110VCT | 3 | 12...44 |
| DG 300VCT | 4 | 40...120 |


Scope of delivery:

- 1 x gas pressure switch with 18" connection wires,
- 2 x retaining screws,
- 2 x sealing rings.

8.1.3 Installation on VAS 1-3


Monitor the inlet pressure p_e : The plug of the pressure switch for gas points towards the inlet flange.

Monitor the outlet pressure p_d : The plug of the pressure switch for gas points towards the outlet flange.

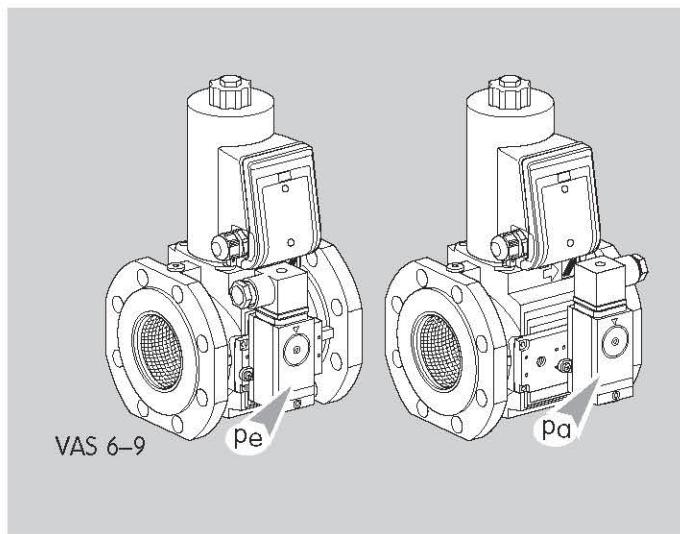

8.1.4 Installation on VAS 6-9

Monitor the inlet pressure p_e : The pressure switch for gas is mounted on the inlet side. Monitor the outlet pressure p_a : The pressure switch for gas is mounted on the outlet side.

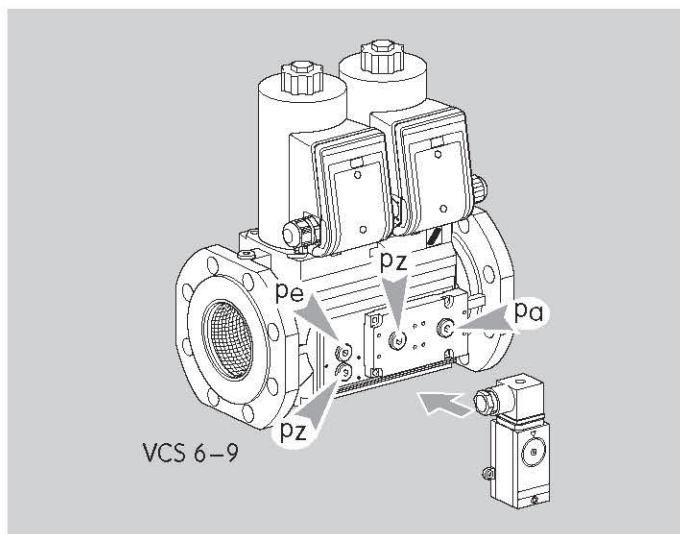


8.1.5 Installation on VCS 6-9


Monitor the inlet pressure p_e : The pressure switch for gas is mounted on the upper part of the flow body.

Monitor the interspace pressure p_z : The pressure switch for gas is mounted on the lower part of the flow body or on the adapter plate at the left-hand side.

Monitor the outlet pressure p_a : The pressure switch for gas is mounted on the adapter plate at the outlet side.

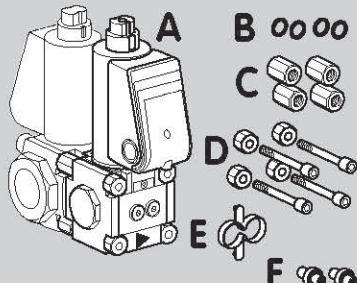

VAS 1 → VAS 1

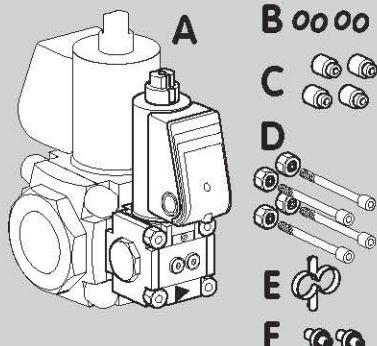

VAS 1 → VAS 2, VAS 3

8.2 Bypass/pilot gas valve VAS 1

8.2.1 Scope of delivery, VAS 1 attached to VAS 1

- A** 1x bypass valve VAS 1,
- B** 4x O-rings,
- C** 4x double nuts,
- D** 4x connection parts,
- E** 1x Mounting aid.

Bypass valve VAS 1

F 2x connection pipe, if the bypass valve has a blind flange at the outlet side.

Pilot gas valve VAS 1

F 1x connection pipe, 1x sealing plug, if the pilot gas valve has a threaded flange at the outlet side.

8.2.2 Scope of delivery, VAS 1 attached to VAS 2, VAS 3


- A** 1x bypass valve VAS 1,
- B** 4x O-rings,
- C** 4x spacer sleeves,
- D** 4x connection parts,
- E** 1x Mounting aid.

Bypass valve VAS 1

F 2x connection pipe, if the bypass valve has a blind flange at the outlet side.

Pilot gas valve VAS 1

F 1x connection pipe, 1x sealing plug, if the pilot gas valve has a threaded flange at the outlet side.

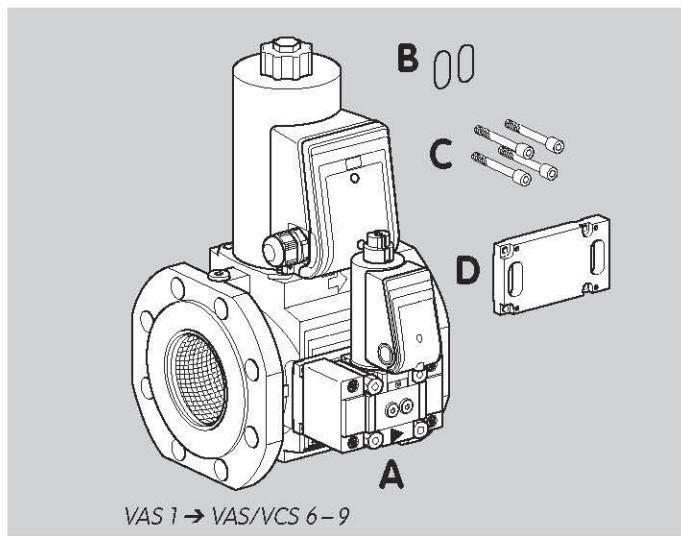

8.2.3 Scope of delivery, VAS 1 attached to VAS/VCS 6–9

- A** 1x bypass valve VAS 1,
- B** 2x O-rings,
- C** 4x connection parts,
- D** 1x bypass adapter plate


Bypass valve VAS 1:

2x adapter flanges


Pilot gas valve VAS 1:

1x adapter flange,


1x adapter flange with threaded hole

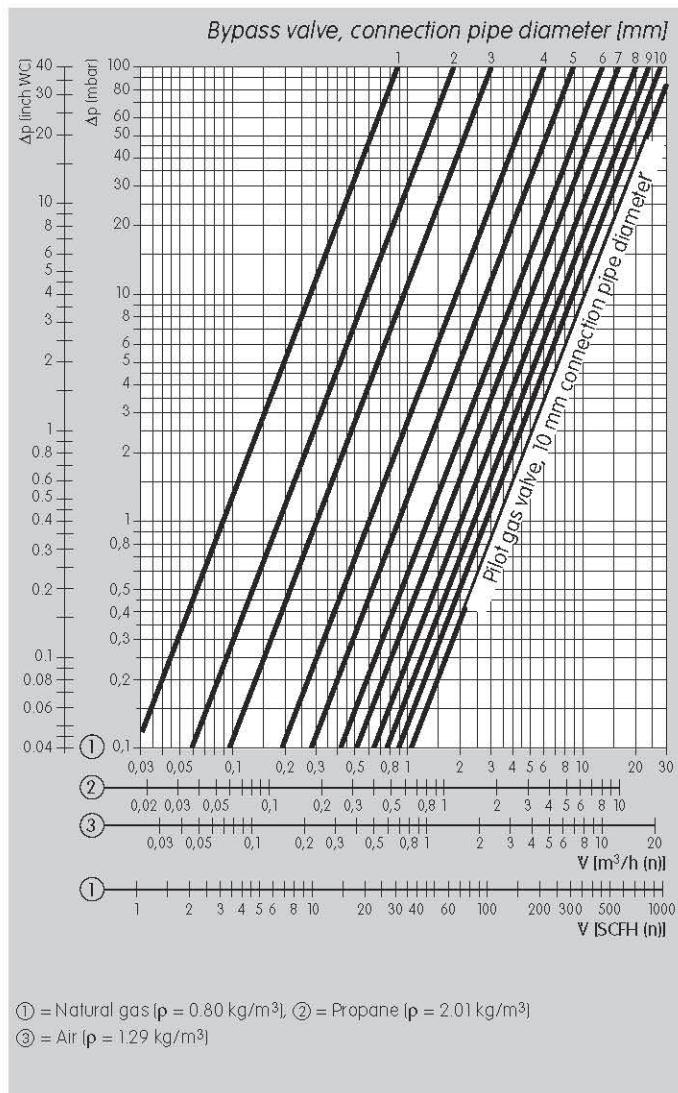


8.2.4 Flow rate, VAS 1 attached to VAS 1, VAS 2, VAS 3

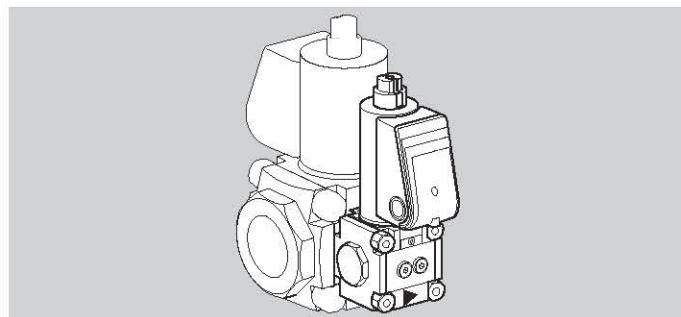


The characteristic flow rate curves have been measured for bypass valve VAS 1 with connection pipe diameter 1 to 10 mm and for the pilot gas valve with 10 mm connection pipe.

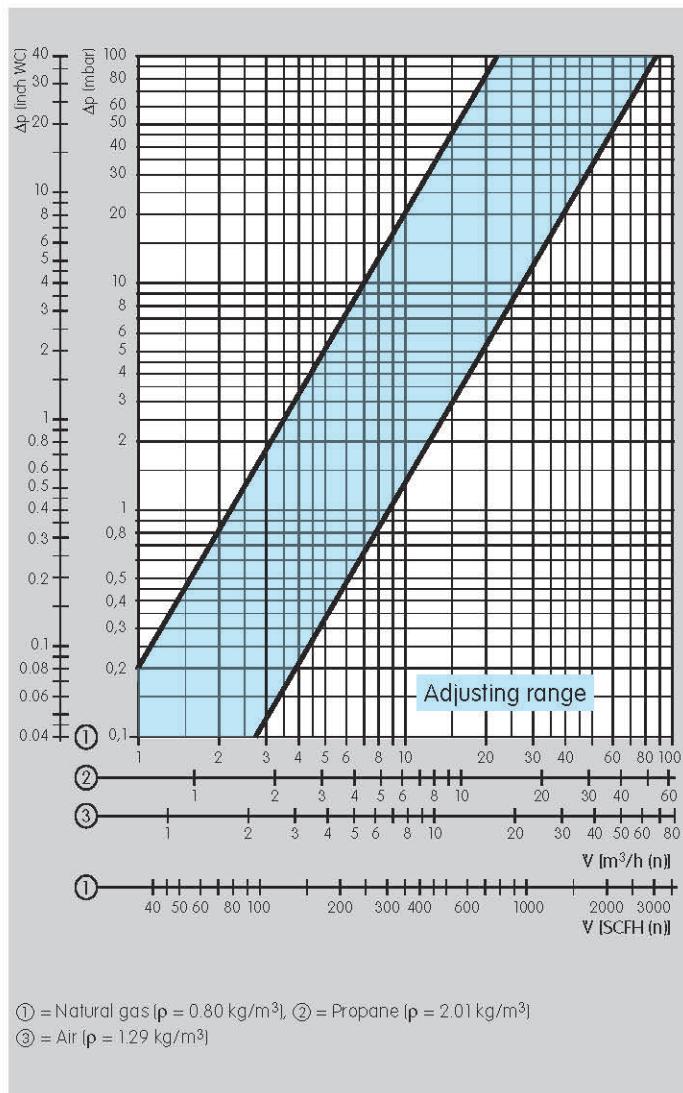

8.2.5 Flow rate, VAS 1 attached to VAS/VCS 6 – 9

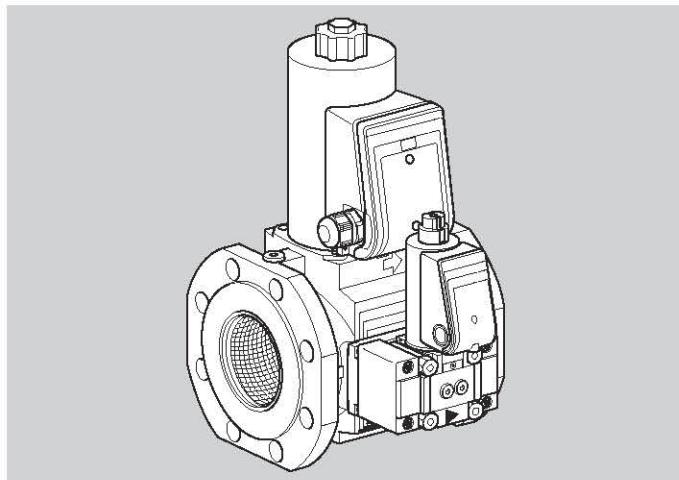

The adjusting range for the bypass valve, and pilot gas valve VAS 1, was determined using the values measured for open flow adjustment (V_{\max}) and fully reduced flow adjustment (V_{\min}).

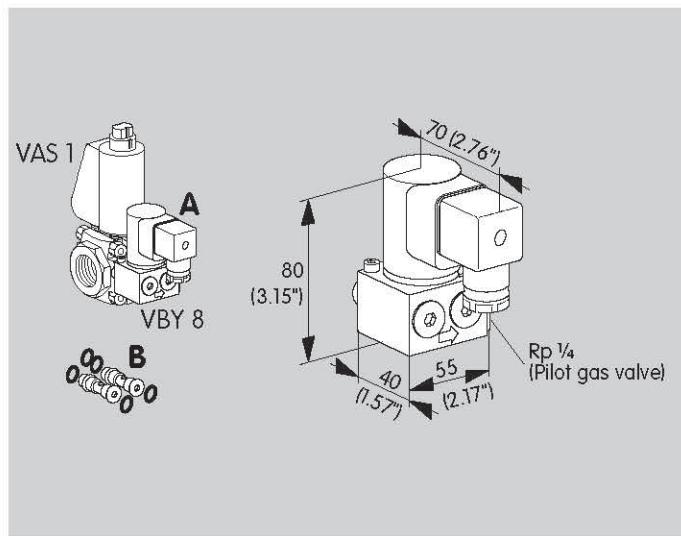

8.3 Bypass/pilot gas valve VBY 8

For mounting on gas solenoid valve VAS 1 and double solenoid valve VCS 1.

8.3.1 Scope of delivery, as bypass valve

A 1x bypass valve VBY 8

B 2x retaining screws with 4x O-rings: Both retaining screws have a bypass orifice.


8.3.2 Scope of delivery, as pilot gas valve

A 1x pilot gas valve VBY 8

B 2x retaining screws with 5x O-rings: Only one of the retaining screws has a bypass orifice.

8.3.3 Selection

| Type | I | R | W | Q | K | 6L | -R | -L | E | B | D | 05 | Example |
|--|-----|-----|------|------|------|-----|----|----|---|---|---|----|---------------|
| VBY 8 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | VBY 8RW6L-LED |
| Bypass valve (internal bypass) | = I | | | | | | | | | | | | |
| Pilot gas valve (Rp internal thread at the outlet) | = R | | | | | | | | | | | | |
| Mains voltage: 24 V DC | | = K | | | | | | | | | | | |
| 120 V AC, 50/60 Hz | | = Q | | | | | | | | | | | |
| 230 V AC, 50/60 Hz | | = W | | | | | | | | | | | |
| Electrical connection via plug and socket with LED | | | = 6L | | | | | | | | | | |
| Attachment side of main valve: right-hand side | | | | = -R | | | | | | | | | |
| Attachment side of main valve: left-hand side | | | | | = -L | | | | | | | | |
| Attached to the VAS | | | | | = E | | | | | | | | |
| Enclosed (separate packing unit) | | | | | = B | | | | | | | | |
| Flow adjustment | | | | | | = D | | | | | | | |
| Nozzle diameter | | | | | | | | | | | | | 0.5 mm |

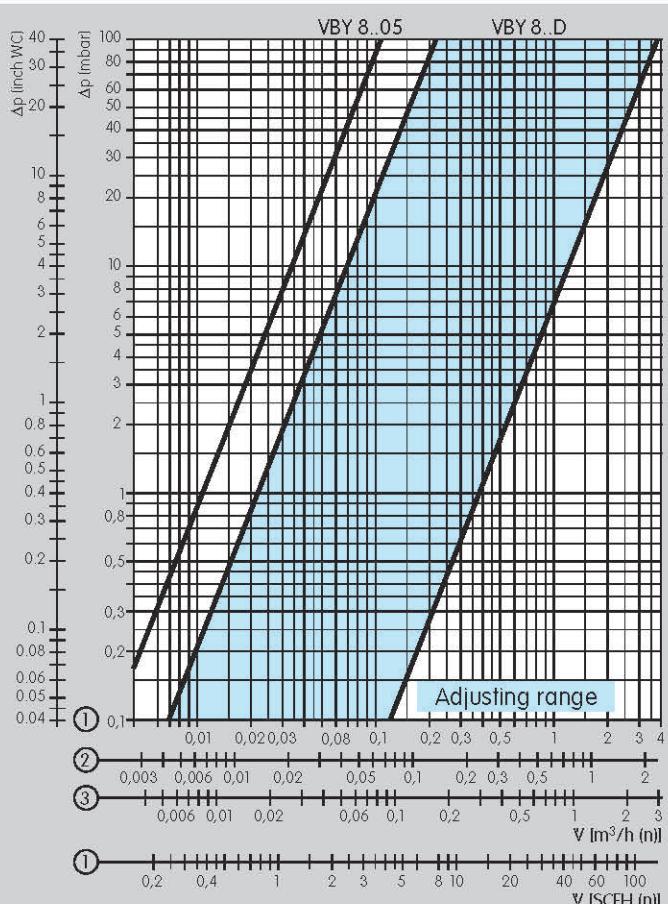


8.3.4 Flow rate

VBY 8..D

The flow rate can be set by turning the flow rate restrictor (4 mm allen screw) $\frac{1}{4}$ of a turn.

Max. flow rate: 10 to 100%.



VBY 8..05

The flow is routed through a 0.5 mm nozzle (0.02 inches) and thus has a fixed characteristic flow rate curve.

Adjustment is not possible.

8.3.5 Technical data

Ambient temperature:

0 bis $+60^\circ\text{C}$ ($32\ldots140^\circ\text{F}$), no condensation permitted.

Storage temperature:

0 bis $+40^\circ\text{C}$ ($32\ldots104^\circ\text{F}$), no condensation permitted.


Power consumption:

24 V = 8 W,

120 V = 8 W,

230 V = 9,5 W

Enclosure: IP 54

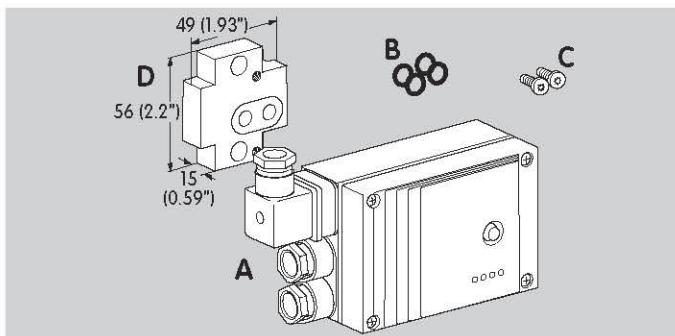

8.4 Tightness control TC 116V

for VAS 1–3

Scope of delivery


- A** 1x tightness control TC 116V
- B** 4x O-rings
- C** 2x retaining screws

An adapter plate is required to attach the tightness control to the right- or left-hand side of the gas solenoid valve:

D 1x adapter plate

For attachment to: left-hand side: Order No. 74922391

right-hand side: Order No. 74921995

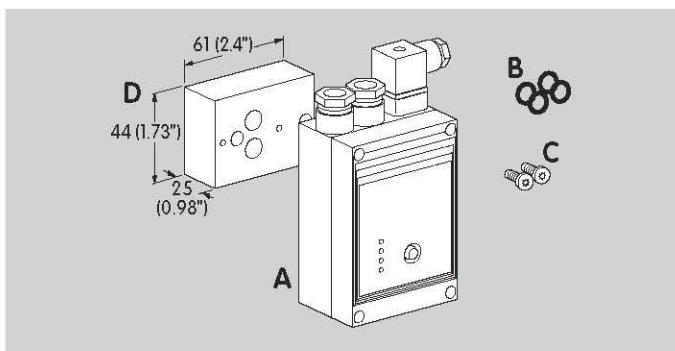


for VCS 6–9:

Scope of delivery

- A** 1x tightness control TC 116V
- B** 4x O-rings
- C** 2x retaining screws


An adapter plate is required to attach the tightness control to the double solenoid valve:

D 1x adapter plate, Order No. 74922822

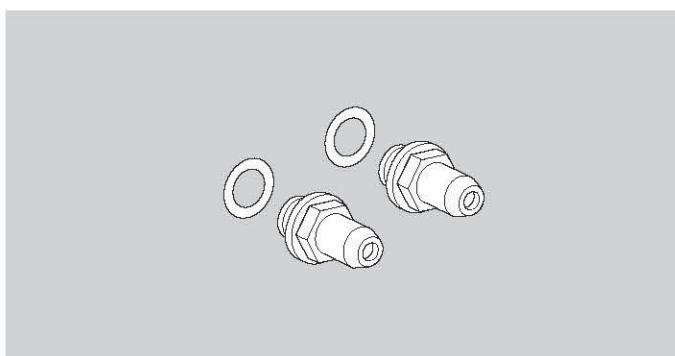

8.5 Pressure test points


Test points to check the inlet pressure p_e and outlet pressure p_a .

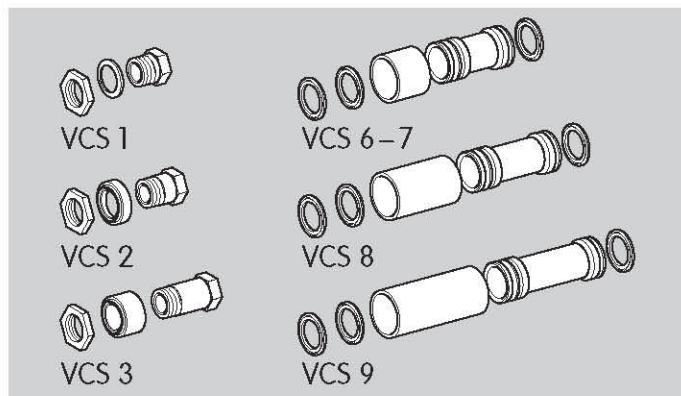

8.6 Grommet

When wiring double solenoid valve VCS 1–9, the connection boxes are to be connected using a grommet.

The grommet can only be used if the connection boxes are at the same height and on the same side and if both valves are equipped either with or without a position indicator.

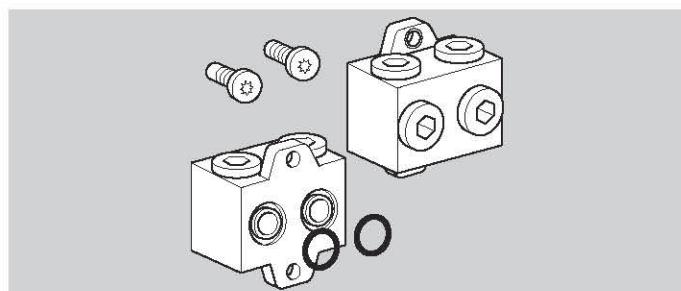


8.7 Attachment block

For locked installation of pressure gauge or other accessories on the gas solenoid valve VAS 1–3.

Scope of delivery:

- 2x self-tapping screws for installation,
- 2x O-rings.

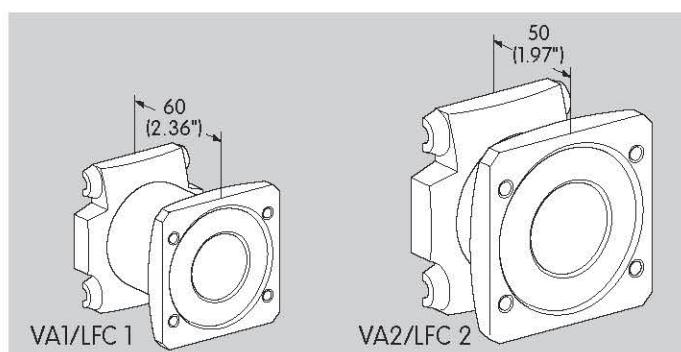

8.8 Flange set for Moduline


For attaching VAS/VCS 1, VAS/VCS 2 to Moduline controls, sizes 1 and 2:

Flange set VA 1/LFC 1, Order No. 74922171,

Flange set VA 2/LFC 2, Order No. 74922172.

Scope of delivery:


- 1x flange,
- 1x O-ring,
- 4x cheese-head screws,
- 4x square nuts.



8.9 Adapter plates for VAS/VCS 6–9


8.9.1 Bypass adapter plate

For the connection of the bypass/pilot gas valve VAS 1.




8.9.2 Measuring adapter plate

For the connection of the pressure switch DG..VC with screw plug or pressure test point.



8.9.3 Pipe adapter plate for VCS 6–9

For the connection of a relief line (1½ NPT, Rp 1) with screw plug or pressure test point.

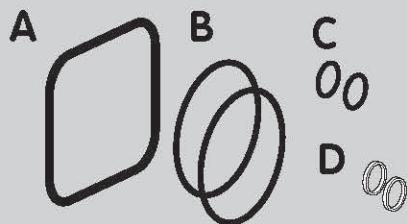

8.10 Seal set VA 1–3

Scope of delivery:

- A** 1 x double block seal,
- B** 2 x O-rings (flange),
- C** 2 x O-rings (pressure switch),
- D** 2 x sealing rings (test nipple).

9 Technical data

Types of gas: Natural gas, LPG (gaseous), biologically produced methane (max. 0.1 %-by-vol. H₂S) or air; other gases on request.

The gas must be dry in all temperature conditions and must not condense.

Max. inlet pressure p_e: 500 mbar (7 psig).

FM approved, non operational pressure: 700 mbar (10 psig).

CSA approved: 350 mbar (5 psig).

Flow adjustment limits the maximum flow volume between 20 and 100%. On VAS 1–3, the setting can be monitored on an indicator.

Adjustment of the start gas rate: 0 to 70%.

Opening times:

VAS..N quick opening: ≤ 1 s;

VAS..L slow opening: up to 30 s.

Closing time:

VAS..N, VAS..L quick closing: < 1 s.

Ambient temperature: -20 – +60 °C (-4 – +140 °F), no condensation permitted.

Storage temperature: -20 – +40 °C (-4 – +104 °F), no condensation permitted.

Safety valve:

Class A Group 2 pursuant to EN 13611 and EN 161,

Factory Mutual Research Class: 7410 and 7411,

ANSI Z21.21 and CSA 6.5.

Mains voltage:

230 V AC, +10/-15%, 50/60 Hz;

120 V AC, +10/-15%, 50/60 Hz;

24 V DC, ±20%.

VAS/VCS 9:

120–230 V~, +10/-15 %, 50/60 Hz.

Cable gland: M20 x 1.5

Electrical connection: max. 2.5 mm² (AWG 12) or plug with socket to EN 175301-803.

Power consumption:

| Type | 24 V= [W] | 120 V~ [W] | 230 V~ [W] |
|-------|-----------|------------|------------|
| VAS 1 | 29 | 30 | 30 |
| VAS 2 | 46 | 54 | 53 |
| VAS 3 | 58 | 63 | 63 |
| VAS 6 | 70 | 63 | 63 |
| VAS 7 | 75 | 90 | 83 |
| VAS 8 | 99 | 117 | 113 |
| VAS 9 | – | 200 (15*) | 200 (15*) |
| VCS 1 | 58 | 60 | 60 |
| VCS 2 | 92 | 108 | 106 |
| VCS 3 | 116 | 126 | 126 |
| VCS 6 | 140 | 126 | 126 |
| VCS 7 | 150 | 180 | 166 |
| VCS 8 | 198 | 234 | 226 |
| VCS 9 | – | 400 (30*) | 400 (30*) |

* After opening.

Enclosure: IP 65.

Duty cycle: 100%.

Power factor of the solenoid coil: $\cos \varphi = 1$.

Switching frequency:

VAS..N: Arbitrary,

VAS..L: There must be a period of 20 seconds between switching off and on again so that the damping is fully effective.

Valve housing: Aluminium,

Valve seal: NBR.

Connection flanges:

VAS/VCS 1-3 with internal thread:

Rp pursuant to ISO 7-1, NPT pursuant to

ANSI/ASME

VAS/VCS 6-9 with ISO flange pursuant to ISO 7005, with ANSI flange pursuant to ASA.

Position indicator contact rating:

| Type | Voltage | min. current (resistive load) | max. current (resistive load) |
|-------------------|--------------------------|----------------------------------|----------------------------------|
| VAS..S, VCS..S | 12...250 V~, 50/60 Hz | 100 mA | 3 A |
| VAS..G, VCS..G | 12...250 V~, 50/60 Hz | 2 mA | 0,1 A |

Switching frequency: 5x per minute.

| switching current [A] | switching cycles | |
|--------------------------|--------------------|----------------------|
| | $\cos \varphi = 1$ | $\cos \varphi = 0,6$ |
| 0.1 | 500,000 | 500,000 |
| 0.5 | 300,000 | 250,000 |
| 1 | 200,000 | 100,000 |
| 3 | 100,000 | — |

VAS/VCS 9

Switching frequency: 1x per minute.


Max. temperature of solenoid coil:

+20°C (+68°F) above ambient temperature.

Current consumption at 20°C (68°F):

Pick-up current: 1.8 A


Holding current: 0.3 A.

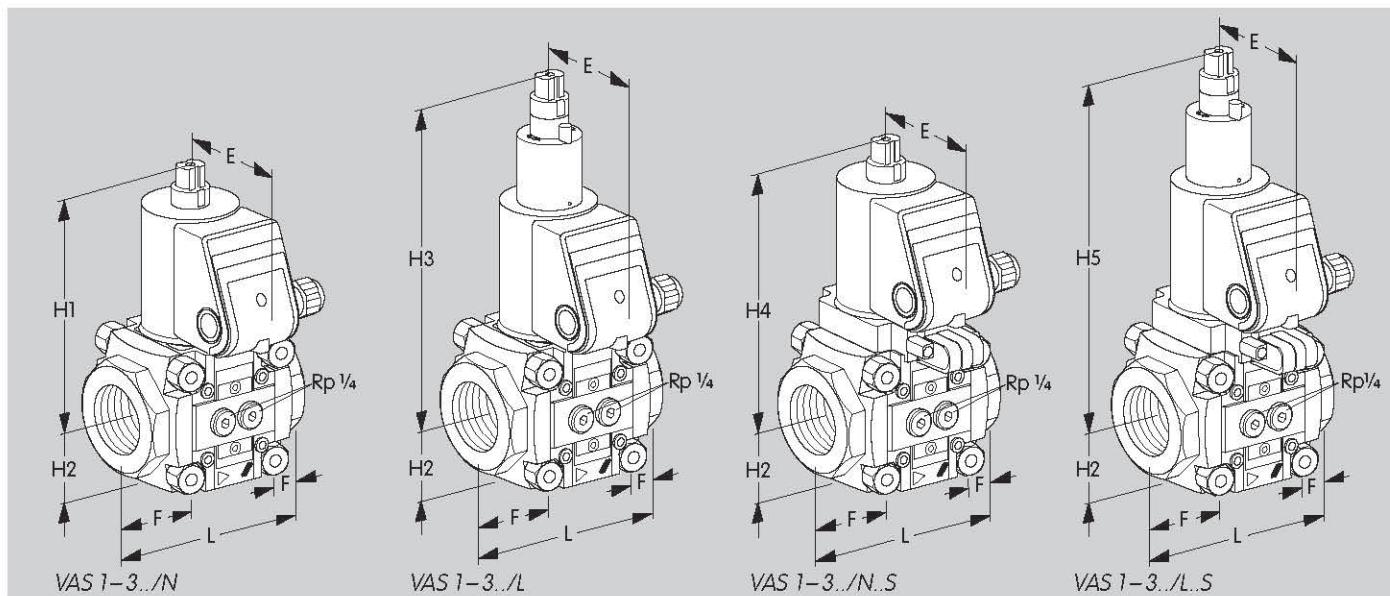

9.1 Dimensions


9.1.1 VAS with Rp internal thread [mm]

| Type | Connection | | Dimensions | | | | | | | | | \dot{V} air for $\Delta p = 1 \text{ mbar}$ m^3/h | | $k_V \text{ max.}$ m^3/h | $k_V \text{ min.}$ m^3/h | Weight kg |
|---------|------------|----|------------|---------|---------|----------|----------|----------|----------|----------|------|---|-----|---|---|--------------|
| | Rp | DN | L mm | E mm | F mm | H1 mm | H2 mm | H3 mm | H4 mm | H5 mm | | | | | | |
| VAS 110 | 3/8 | 10 | 75 | 75 | 15 | 140 | 32 | 209 | 159 | 227 | 4.4 | 5.0 | 2 | 1.4 | | |
| VAS 115 | 1/2 | 15 | 75 | 75 | 15 | 140 | 32 | 209 | 159 | 227 | 5.5 | 6.4 | 2 | 1.4 | | |
| VAS 120 | 3/4 | 20 | 91 | 75 | 23 | 140 | 32 | 209 | 159 | 227 | 8.3 | 9.6 | 2 | 1.5 | | |
| VAS 125 | 1 | 25 | 91 | 75 | 23 | 140 | 32 | 209 | 159 | 227 | 10.0 | 10.9 | 2 | 1.4 | | |
| VAS 225 | 1 | 25 | 127 | 88 | 29 | 164 | 47 | 233 | 185 | 254 | 15.5 | 19.2 | 5.3 | 3.8 | | |
| VAS 232 | 11/4 | 32 | 127 | 88 | 29 | 164 | 47 | 233 | 185 | 254 | 19.5 | 24.1 | 5.3 | 3.7 | | |
| VAS 240 | 11/2 | 40 | 127 | 88 | 29 | 164 | 47 | 233 | 185 | 254 | 21.0 | 26.9 | 5.3 | 3.8 | | |
| VAS 250 | 2 | 50 | 127 | 88 | 29 | 164 | 47 | 233 | 185 | 254 | 22.5 | 26.9 | 5.3 | 3.6 | | |
| VAS 340 | 11/2 | 40 | 155 | 96 | 36 | 229 | 59 | 298 | 250 | 319 | 30.5 | 39.1 | 8.5 | 7.4 | | |
| VAS 350 | 2 | 50 | 155 | 96 | 36 | 229 | 59 | 298 | 250 | 319 | 37.0 | 44.4 | 8.5 | 7.2 | | |
| VAS 365 | 21/2 | 65 | 155 | 96 | 36 | 229 | 59 | 298 | 250 | 319 | 41.0 | 47.4 | 8.5 | 7.0 | | |

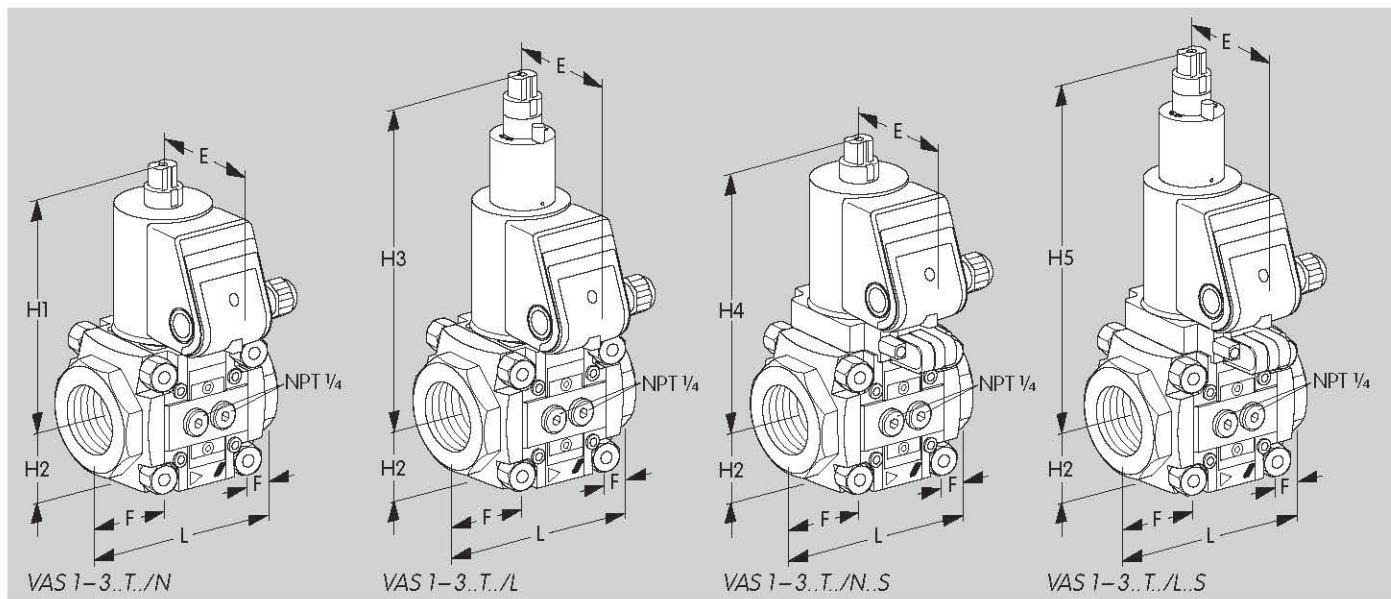


9.1.2 VAS..T with NPT internal thread [inch]

| Type | Connection | | | Dimensions | | | | | | | | Vair for $\Delta p = 0.4 \text{ "WC}$ | Weight | |
|---------|------------|----|-----------|------------|-----------|------------|------------|------------|------------|------------|---------|--|--------|--|
| | NPT | DN | L inch | E inch | F inch | H1 inch | H2 inch | H3 inch | H4 inch | H5 inch | SCFH | lbs | | |
| VAS 110 | 3/8 | 10 | 2.95 | 2.95 | 0.59 | 5.51 | 1.26 | 8.23 | 6.26 | 8.94 | 155.36 | 3.08 | | |
| VAS 115 | 1/2 | 15 | 2.95 | 2.95 | 0.59 | 5.51 | 1.26 | 8.23 | 6.26 | 8.94 | 194.23 | 3.08 | | |
| VAS 120 | 3/4 | 20 | 3.58 | 2.95 | 0.91 | 5.51 | 1.26 | 8.23 | 6.26 | 8.94 | 300.17 | 3.3 | | |
| VAS 125 | 1 | 25 | 3.58 | 2.95 | 0.91 | 5.51 | 1.26 | 8.23 | 6.26 | 8.94 | 374.34 | 3.08 | | |
| VAS 225 | 1 | 25 | 5.00 | 3.47 | 1.14 | 6.46 | 1.85 | 9.17 | 7.28 | 10 | 618.01 | 8.36 | | |
| VAS 232 | 1 1/4 | 32 | 5.00 | 3.47 | 1.14 | 6.46 | 1.85 | 9.17 | 7.28 | 10 | 759.27 | 8.14 | | |
| VAS 240 | 1 1/2 | 40 | 5.00 | 3.47 | 1.14 | 6.46 | 1.85 | 9.17 | 7.28 | 10 | 829.89 | 8.36 | | |
| VAS 250 | 2 | 50 | 5.00 | 3.47 | 1.14 | 6.46 | 1.85 | 9.17 | 7.28 | 10 | 868.74 | 7.92 | | |
| VAS 340 | 1 1/2 | 40 | 6.10 | 3.78 | 1.42 | 9.02 | 6.85 | 11.73 | 9.84 | 12.56 | 1165.38 | 16.28 | | |
| VAS 350 | 2 | 50 | 6.10 | 3.78 | 1.42 | 9.02 | 6.85 | 11.73 | 9.84 | 12.56 | 1447.90 | 15.84 | | |
| VAS 365 | 2 1/2 | 65 | 6.10 | 3.78 | 1.42 | 9.02 | 6.85 | 11.73 | 9.84 | 12.56 | 1518.53 | 15.40 | | |

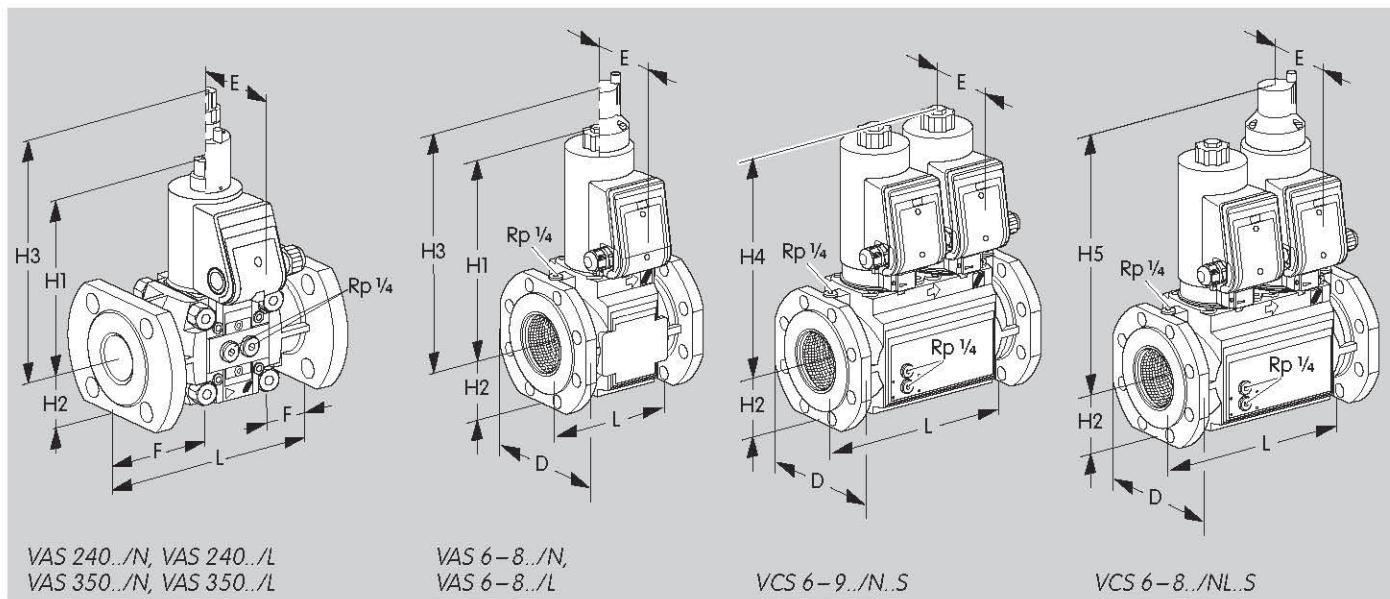

9.1.3 VAS/VCS with ISO flange

| Type | Con- nection DN | Dimensions | | | | | | | | \dot{V}_{air} for $\Delta p = 1$ mbar m ³ /h | $k_{V\ min.}$ m ³ /h | $k_{V\ max.}$ m ³ /h | Weight kg |
|----------|-----------------------|------------|---------|---------|----------|----------|----------|----------|----------|---|------------------------------------|------------------------------------|--------------|
| | | L mm | E mm | F mm | H1 mm | H2 mm | H3 mm | H4 mm | H5 mm | | | | |
| VAS 240 | 40 | 200 | 88 | 66 | 164 | 47 | 233 | — | — | 21.0 | 26.9 | 5.3 | 5.0 |
| VAS 350 | 50 | 230 | 96 | 74 | 229 | 59 | 298 | — | — | 37.0 | 44.4 | 8.5 | 8.7 |
| VAS 665 | 65 | 190 | 106 | 175 | 287 | 77 | 342 | 310 | 365 | 68.4 | 69 | — | 11 |
| VCS 665 | 65 | 290 | 106 | 175 | 287 | 77 | 342 | 310 | 365 | 53.3 | 61 | — | 18 |
| VAS 780 | 80 | 203 | 106 | 190 | 295 | 86 | 350 | 318 | 373 | 97.9 | 112 | — | 12 |
| VCS 780 | 80 | 310 | 106 | 190 | 295 | 86 | 350 | 318 | 373 | 75.8 | 87 | — | 21 |
| VAS 8100 | 100 | 229 | 120 | 210 | 348 | 101 | 403 | 380 | 426 | 148.4 | 171 | — | 23 |
| VCS 8100 | 100 | 350 | 120 | 210 | 348 | 101 | 403 | 380 | 426 | 114.3 | 131 | — | 40 |
| VAS 9125 | 125 | 254 | 120 | 240 | 362 | 114 | — | 394 | — | 222 | 251 | — | 27 |
| VCS 9125 | 125 | 400 | 120 | 240 | 362 | 114 | — | 394 | — | 170.5 | 193 | — | 45 |

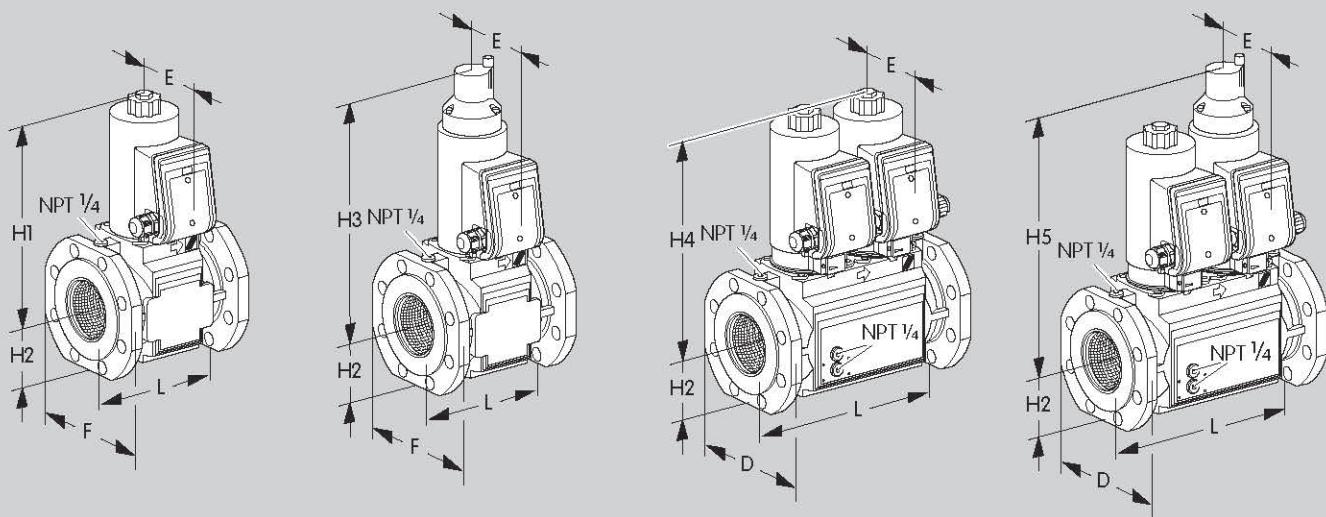

VAS 6-9../N


VAS 6-8../L

VCS 6-9../N..S


VCS 6-8../NL..S

9.1.4 VAS/VCS..T with ANSI flange [inch]

| Type | Connec-tion DN | Dimensions | | | | | | | | Varir for $\Delta p = 0,4 \text{ "WC}$ SCFH | Weight lbs |
|----------|-------------------|------------|-----------|-----------|------------|------------|------------|------------|------------|--|---------------|
| | | L inch | E inch | F inch | H1 inch | H2 inch | H3 inch | H4 inch | H5 inch | | |
| VAS 665 | 65 | 7.48 | 4.17 | 6.89 | 11.3 | 3 | 13.47 | 12.2 | 14.37 | 2415 | 24.25 |
| VCS 665 | 65 | 11.41 | 4.17 | 6.89 | 11.3 | 3 | 13.47 | 12.2 | 14.37 | 1882 | 39.68 |
| VAS 780 | 80 | 7.99 | 4.17 | 7.84 | 11.61 | 3.38 | 13.78 | 12.52 | 14.68 | 3456 | 26.45 |
| VCS 780 | 80 | 12.2 | 4.17 | 7.84 | 11.61 | 3.38 | 13.78 | 12.52 | 14.68 | 2676 | 46.3 |
| VAS 8100 | 100 | 9 | 4.72 | 8.27 | 13.7 | 3.97 | 13.86 | 14.96 | 16.77 | 5240 | 50.71 |
| VCS 8100 | 100 | 13.78 | 4.72 | 8.27 | 13.7 | 3.97 | 13.86 | 14.96 | 16.77 | 4035 | 88.18 |
| VAS 9125 | 125 | 10 | 4.72 | 9.45 | 14.25 | 4.48 | — | 15.51 | — | 7838 | 59.52 |
| VCS 9125 | 125 | 15.75 | 4.72 | 9.45 | 14.25 | 4.48 | — | 15.51 | — | 6020 | 99.21 |

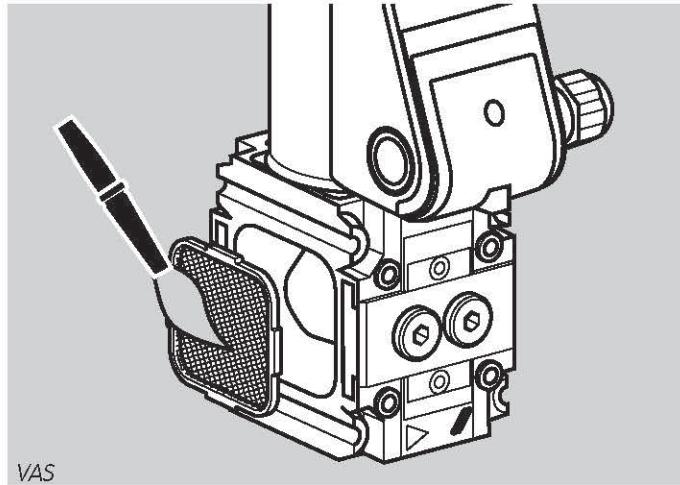

VAS

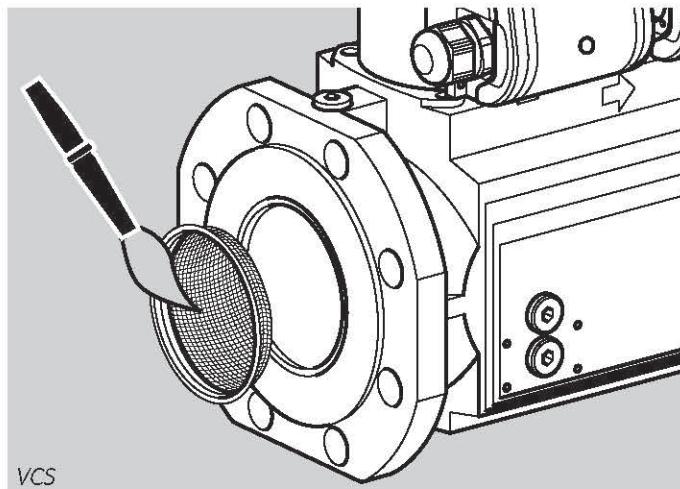

VCS

10 Maintenance cycles

At least once per annum, at least twice per annum for biologically produced methane.